



MIAMI-DADE COUNTY
BUILDING AND NEIGHBORHOOD COMPLIANCE DEPARTMENT (BNC)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/building/home/asp

Lawson Industries, Inc.
8501 NW 90th Street
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Section and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HS-8500 (Flange Mount)" Aluminum Horizontal Sliding Window – N.I.

APPROVAL DOCUMENT: Drawing No. **L8500-0401**, titled "HS-8500 Horizontal Rolling Flange Window", sheets 1 through 9 of 9, prepared by manufacturer, dated 05/02/05 with revision dated 07/02/09, signed and sealed by Thomas J. Sotos, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration0 date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA **revises and renews** NOA # **09-0720.07** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.
The submitted documentation was reviewed by **Manuel Perez, P.E.**



NOA No. 10-1025.04
Expiration Date: January 26, 2016
Approval Date: February 03, 2011
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **L8500-0401**, titled "HS-8500 Horizontal Rolling Flange Window", sheets 1 through 9 of 9, prepared by manufacturer, dated 05/02/05 with revision dated 07/22/09, signed and sealed by Thomas J. Sotos, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing Laboratory, Inc., Test Report No. **HETI-08-2158**, dated 09/03/08, signed and sealed by Candido Font, P.E. *(Submitted under previous NOA #09-0720.07)*
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing Laboratory, Inc., Test Report No. **HETI-08-2159**, dated 09/03/08, signed and sealed by Candido Font, P.E. *(Submitted under previous NOA #09-0720.07)*
3. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing Laboratory, Inc., Test Report No. **HETI-08-2160**, dated 09/03/08, signed and sealed by Candido Font, P.E. *(Submitted under previous NOA #09-0720.07)*
4. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4541**, dated 06/24/05, signed and sealed by Edmundo Largaespada, P.E. *(Submitted under previous NOA #09-0720.07)*
5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4533**, dated 06/22/05, signed and sealed by Edmundo Largaespada, P.E. *(Submitted under previous NOA #09-0720.07)*


Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-1025.04

Expiration Date: January 26, 2016
Approval Date: February 03, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

6. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4553**, dated 06/22/05, signed and sealed by Edmundo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
7. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 along with marked-up drawings and installation diagram of a aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4456**, dated 06/23/05, signed and sealed by Edmundo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
8. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4413**, dated 06/23/05, signed and sealed by Edmundo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
9. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4547**, dated 06/23/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
10. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4429**, dated 06/24/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
11. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of aluminum single hung, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4457**, dated 06/24/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)



Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-1025.04

Expiration Date: January 26, 2016
Approval Date: February 03, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

12. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4594**, dated 06/24/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
13. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4588**, dated 06/24/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)
14. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94 along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-4578**, dated 06/24/05, signed and sealed by Eduardo Largaespada, P.E.
(Submitted under previous NOA #09-0720.07)

C. CALCULATIONS:

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by manufacturer, dated 8/15/05, 7/1/09 and 7/16-17/09, signed and sealed by Thomas J. Sotos, P.E.
2. Glazing complies with **ASTM E1300-98/04**.

D. QUALITY ASSURANCE

1. Miami-Dade Building and Neighborhood Compliance Department (BNC).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **06-0216.06** issued to **Solutia, Inc.** for their "Saflex III G Clear or colored Interlayer" dated 05/04/06, expiring on 05/21/11.

F. STATEMENTS

1. Statement letter of conformance, dated 07/07/09, signed and sealed by Thomas J. Sotos, P.E.
2. Statement letter of no financial interest, dated 07/01/09, signed and sealed by Thomas J. Sotos, P.E.
3. Proposal No. **07-3077** issued by BNC, dated August 9, 2007, signed by Manuel Perez, P. E.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-1025.04

Expiration Date: January 26, 2016
Approval Date: February 03, 2011

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)


4. Laboratory compliance letter for Test Report No. **FTL-4413**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
5. Laboratory compliance letter for Test Report No. **FTL-4456**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
6. Laboratory compliance letter for Test Report No. **FTL-4457**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
7. Laboratory compliance letter for Test Report No. **FTL-4533**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
8. Laboratory compliance letter for Test Report No. **FTL-4541**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
9. Laboratory compliance letter for Test Report No. **FTL-4547**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
10. Laboratory compliance letter for Test Report No. **FTL-4553**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
11. Laboratory compliance letter for Test Report No. **FTL-4578**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.
12. Laboratory compliance letter for Test Report No. **FTL-4594**, issued by Fenestration Testing Laboratory, Inc., dated July 21, 2005, signed and sealed by Edmundo Largaespada, P.E.

G. OTHERS

1. Notice of Acceptance No. **09-0720.07**, issued to Lawson Industries, Inc. for their Series HS-8500 Aluminum Horizontal Sliding Window (Flange Mount) – N.I., approved on 10/28/09 and expiring on 01/26/11.



Manuel Perez, P.E.
Product Control Examiner
NOA No. 10-1025.04

Expiration Date: January 26, 2016
Approval Date: February 03, 2011

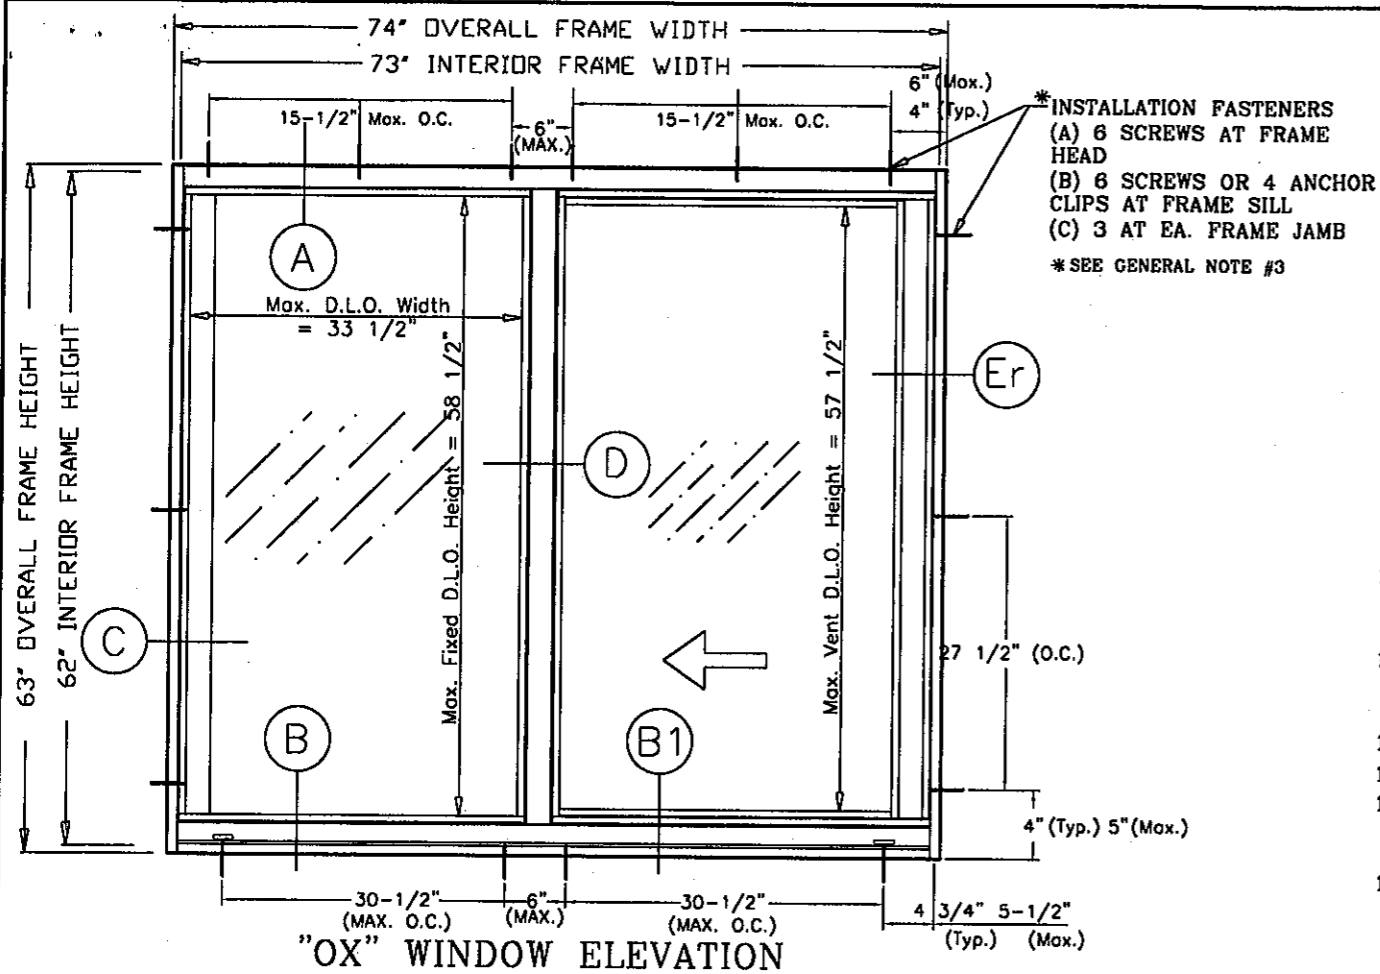

General Notes:

- 1.) THIS WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2007 FLORIDA BUILDING CODE AND ASTM 1300-02. THIS PRODUCT IS NOT IMPACT RESISTANT AND WINDOWS ARE TO BE PROTECTED WITH A MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTER.
- 2.) 1 X OR 2 X WOOD BUCKS SHALL BE INSTALLED AND ANCHORED SO THAT THE BUILDING RESISTS THE SUPERIMPOSED LOADS IN ACCORDANCE WITH THE REQUIREMENTS OF 2007 & TO BE REVIEWED BY BUILDING OFFICIAL.
- 3.) ANCHORS SHOWN ABOVE ARE AS PER TEST UNITS. ON CENTER (O.C.). ANCHOR SPACINGS WILL VARY WITH UNIT DIMENSIONS, AND THE NUMBER OF ANCHORS REQUIRED, AS SPECIFIED ON THE LOAD TABLES.
- 4.) ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
- 5.) FRAME INSTALLATION SHIMS IF USED; SHALL BE LOAD BEARING.
- 6.) XO or OX WINDOWS ARE QUALIFIED FOR USE WITH SINGLE GLAZE GLASS TYPES TABULATED HEREIN (SEE SHEET # 5 & 6).
- 7.) XOX WINDOWS ARE QUALIFIED FOR USE WITH SINGLE GLAZE GLASS TYPES TABULATED HEREIN (SEE SHEET #7).
- 8.) XO, OX, XOX WINDOWS ARE QUALIFIED FOR USE WITH DOUBLE GLAZE GLASS TYPES TABULATED HEREIN (SEE SHEET #8).
- 9.) SEE SHEET 4 FOR LOCK DETAILS & OPTIONS.
- 10.) SEE SHEET 4 FOR GLAZING DETAILS & OPTIONS (REFER TO SHEETS 5, 6, 7 & 8 FOR DESIGN PRESSURES).
- 11.) TEMPERED GLASS MAY BE USED, BUT DESIGN PRESSURES ARE LIMITED TO LOAD TABLES ON SHEET # 6 FOR XO UNITS AND SHEETS # 7 & 8 FOR XOX UNITS.
- 12.) FRAME SILL ANCHOR CLIPS TO BE MEASURED FROM THE INSIDE EDGE OF THE WINDOW FRAME AND TO BE LOCATED WITHIN A +/- 1/4" TOLERANCE. ANCHORS REQUIRED AT FRAME SILL TO BE THE SAME AS FRAME HEAD.
- 13.) SEE SHEET #6 FOR FLANGE PERIMETER CAULK/ INSTALLATION DETAIL.
- 14.) APPROVAL APPLIES TO SINGLE UNITS OR MULTIPLE UNITS AND MAY BE MULLED VERTICALLY OR HORIZONTALLY.
- 15.) MULLING SINGLE HUNG WINDOWS WITH OTHER TYPES OF MIAMI-DADE COUNTY APPROVED WINDOWS USING A MIAMI-DADE COUNTY APPROVED MULLION IN BETWEEN ARE ACCEPTABLE BUT THE LOWER DESIGN PRESSURE FROM THE WINDOWS OR MULLION APPROVAL WILL APPLY TO THE ENTIRE MULLED SYSTEM.
- 16.) SEE SHEET # 9 FOR MULLION/METAL ATTACHMENT DETAILS & NOTES.

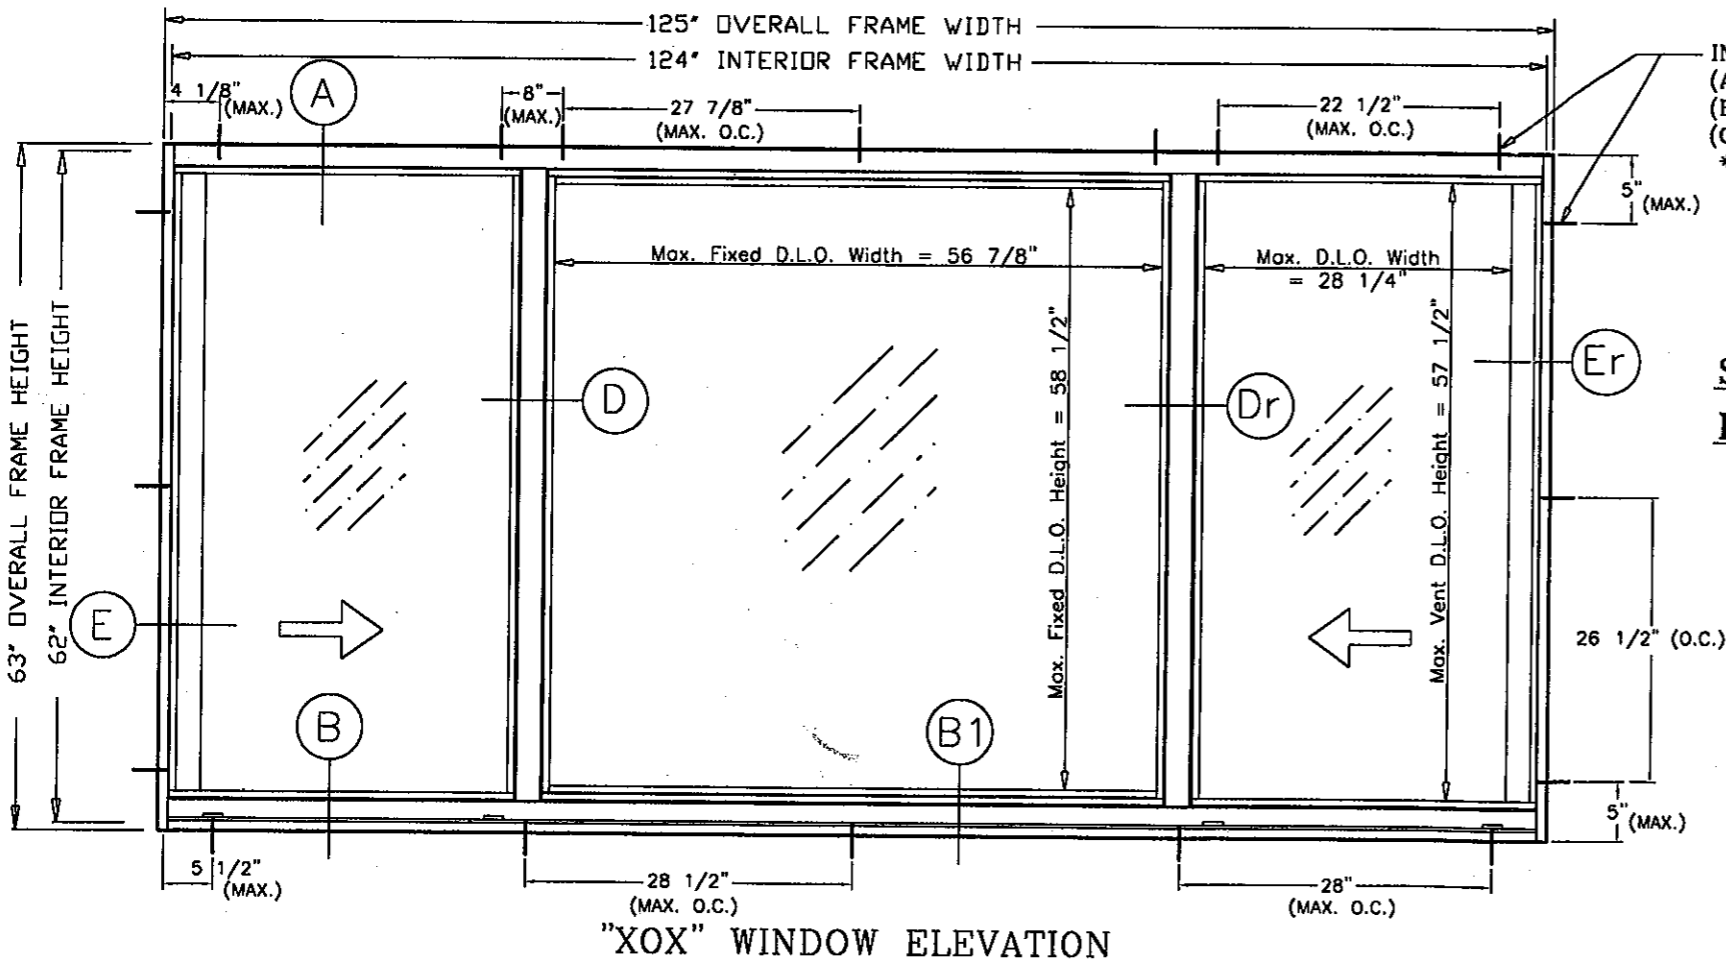


WINDOWS ARE TO BE PROTECTED WITH MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS

SERIES-8500 HORIZONTAL SLIDING WINDOW FLANGE FRAME - (NON-IMPACT)

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No 10-1025-04
Expiration Date JAN 26, 2016
By *Manuel Perez*
Miami Dade Product Control Division

Revision Notes: Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.	Date Drawn: 05/08/05
Drawn By: N. ERAZO	Date Revised: 07/2/09
Checked By: N. ERAZO	Scale:
Revision Level:	

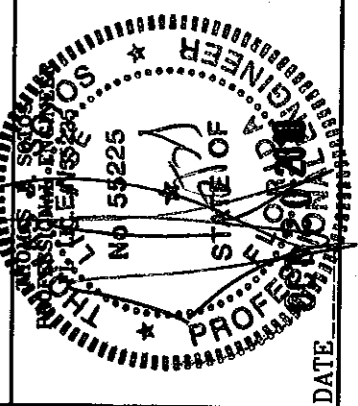

8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

LAWSON INDUSTRIES, INC.

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

HS-8500 HORIZONTAL ROLLING FLANGE WINDOW

APPROVED ELEVATIONS, CONFIGURATIONS AND NOTES


Product Reference Number: L8500-0401

Drawing Number: L8500-0401


Sheet 1 OF 9

Revision #:


DATE

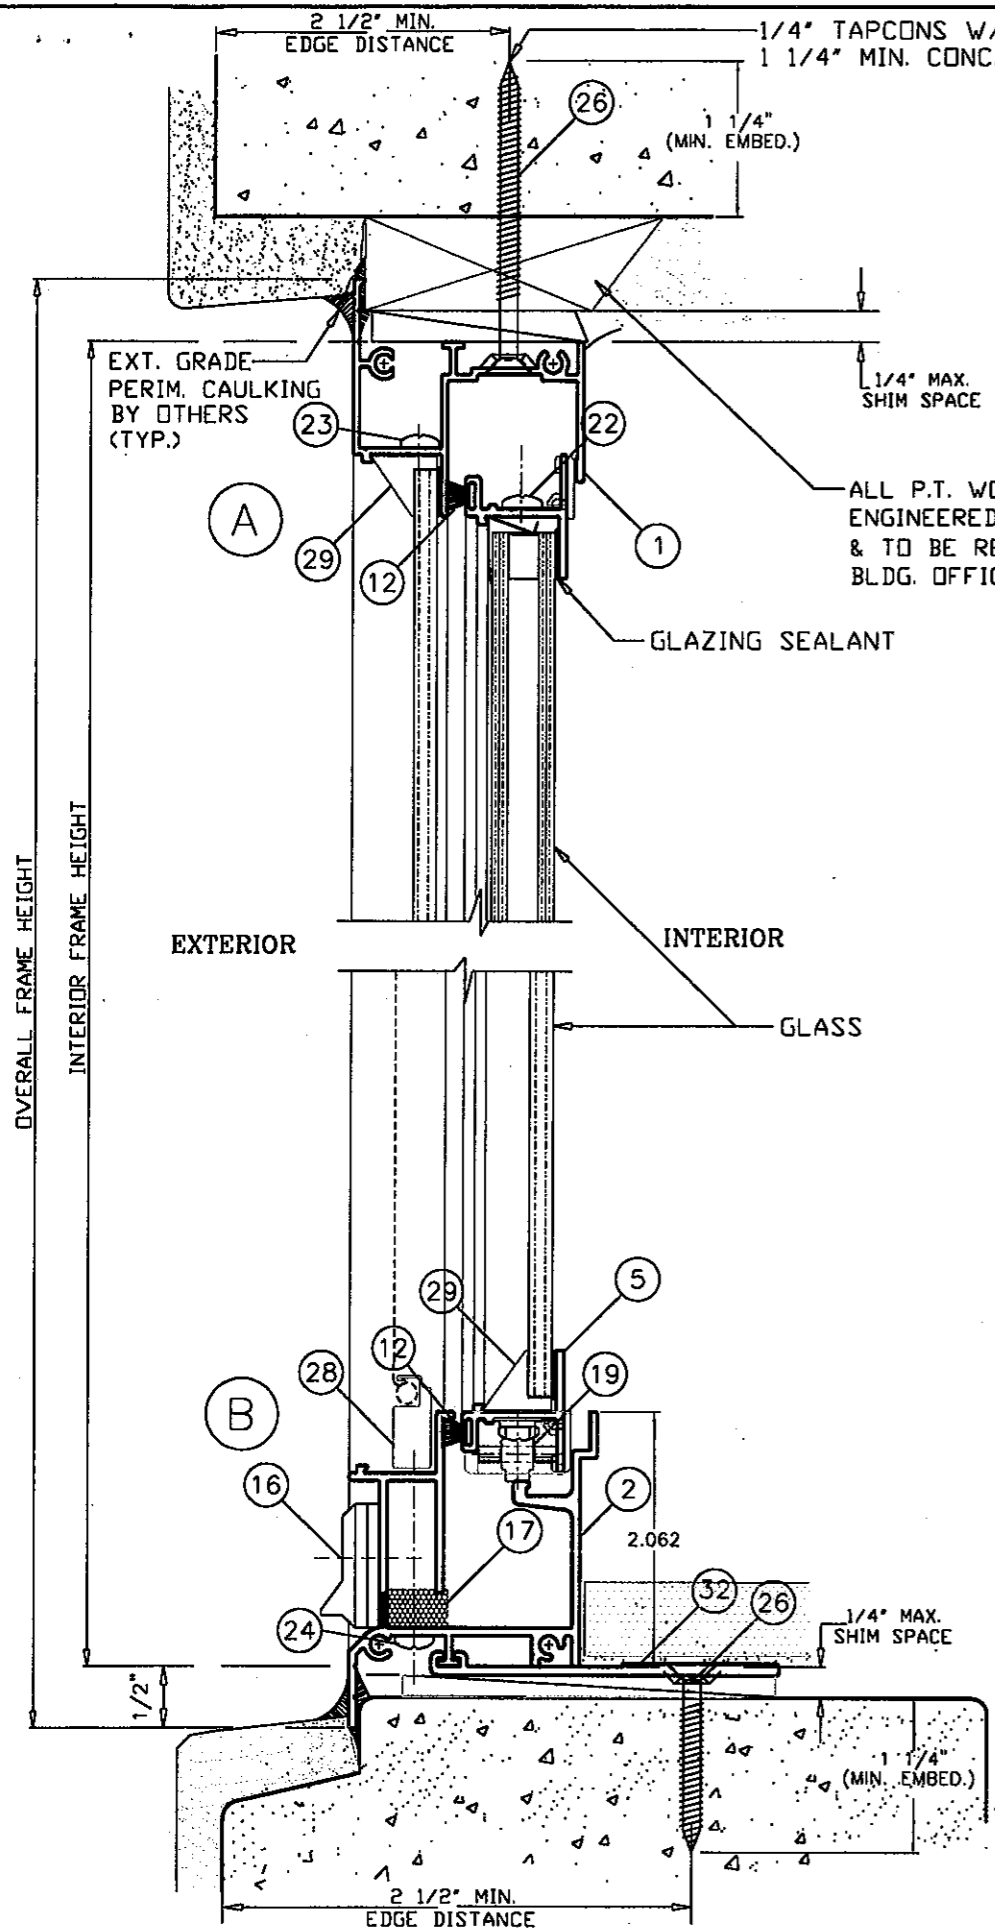

ALL P.T. WOOD BUCKS ENGINEERED SEPARATELY & TO BE REVIEWED BLDG. OFFICIAL (TYP.)

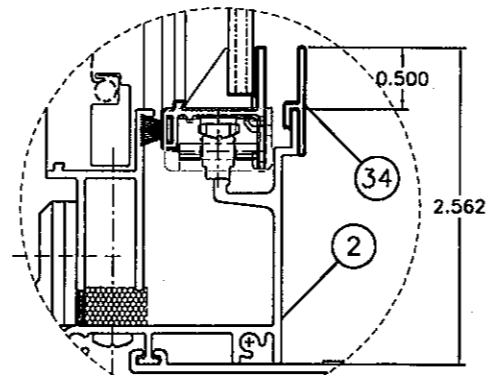

SILL W/ 1/2" RISER ADAPTER (FIELD APPLIED W/ CLEAR SILICONE)

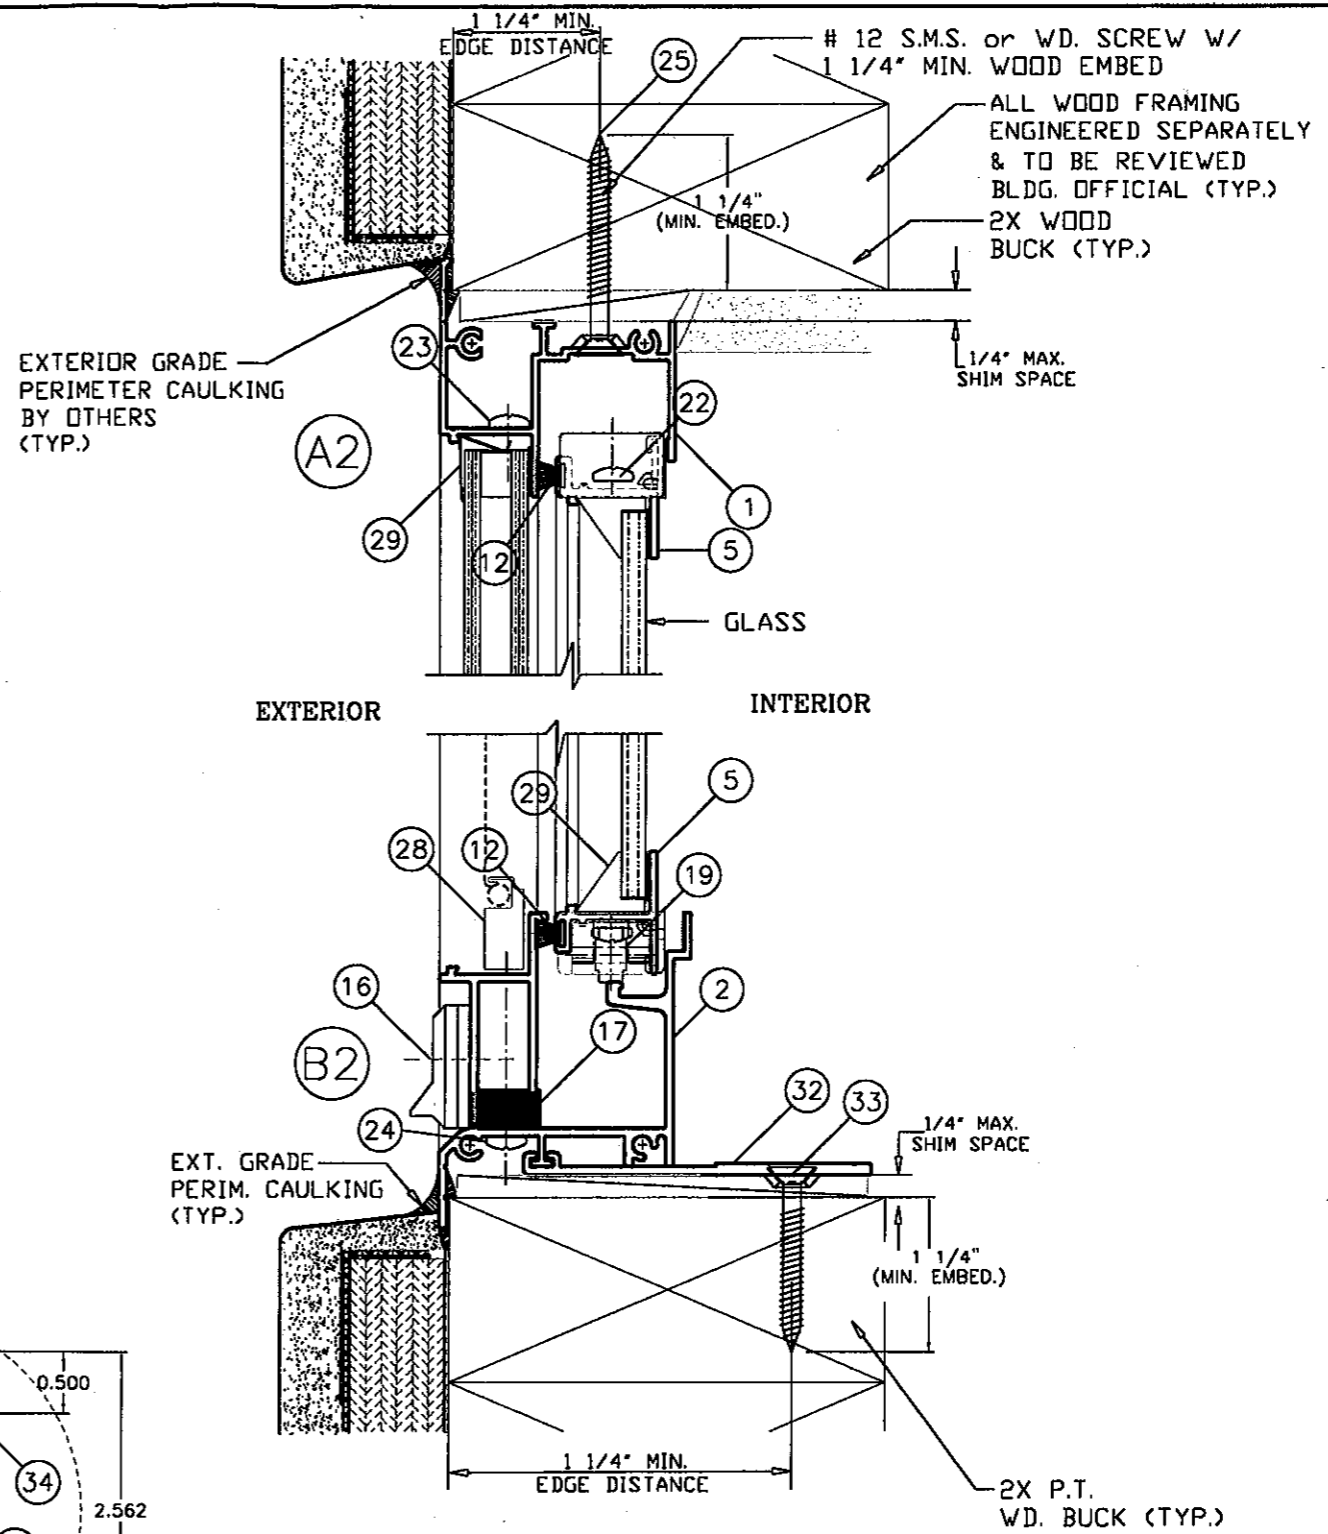

ANCHORS NOTE:
 ANCHORS TO BE #12 SMS OR WD. SCREWS INTO WOOD, OR 1/4" TAPCONS OR APPROVED CONC. FASTENERS INTO CONC., WITH A MINIMUM OF 1 1/4" PENETRATION INTO WOOD OR CONC. (REFER TO LOAD TABLES FOR QUANTITIES REQUIRED)

* WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No 10-1025-04
 Expiration Date JAN. 26, 2016
 By *Manuel Perez*
 Miami Dade Product Control Division


LAWSON
 INDUSTRIES, INC.



8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

HS-8500 HORIZONTAL ROLLING FLANGE WINDOW
 WINDOW VERTICAL CROSS SECTION & DETAILS

Revision Notes: Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.	Date Drawn: 05/02/05
Drawn By: N. ERAZO	Date Revised: 07/2/09
Checked By: N. ERAZO	Scale:
Revision Level:	

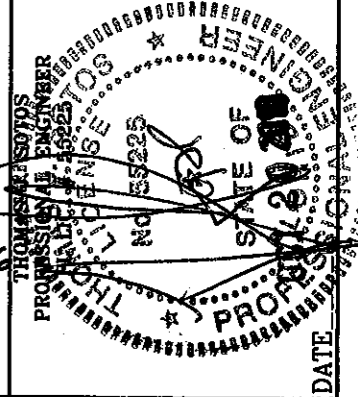

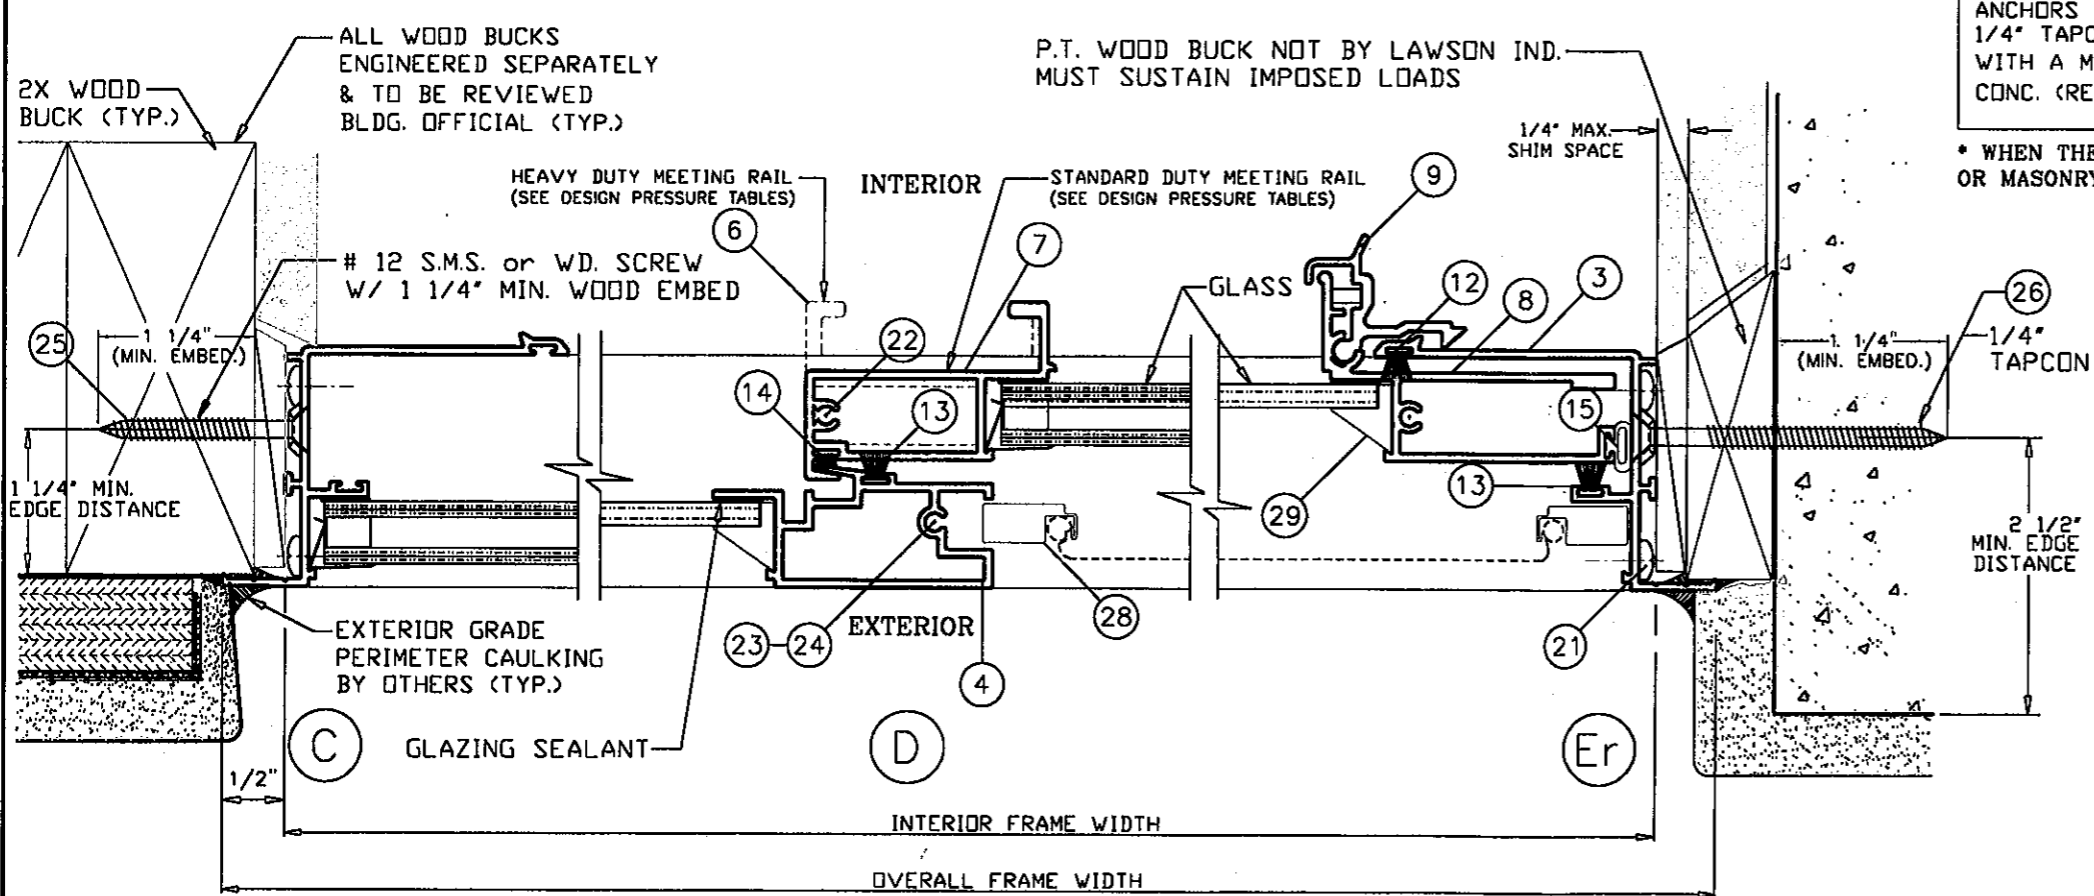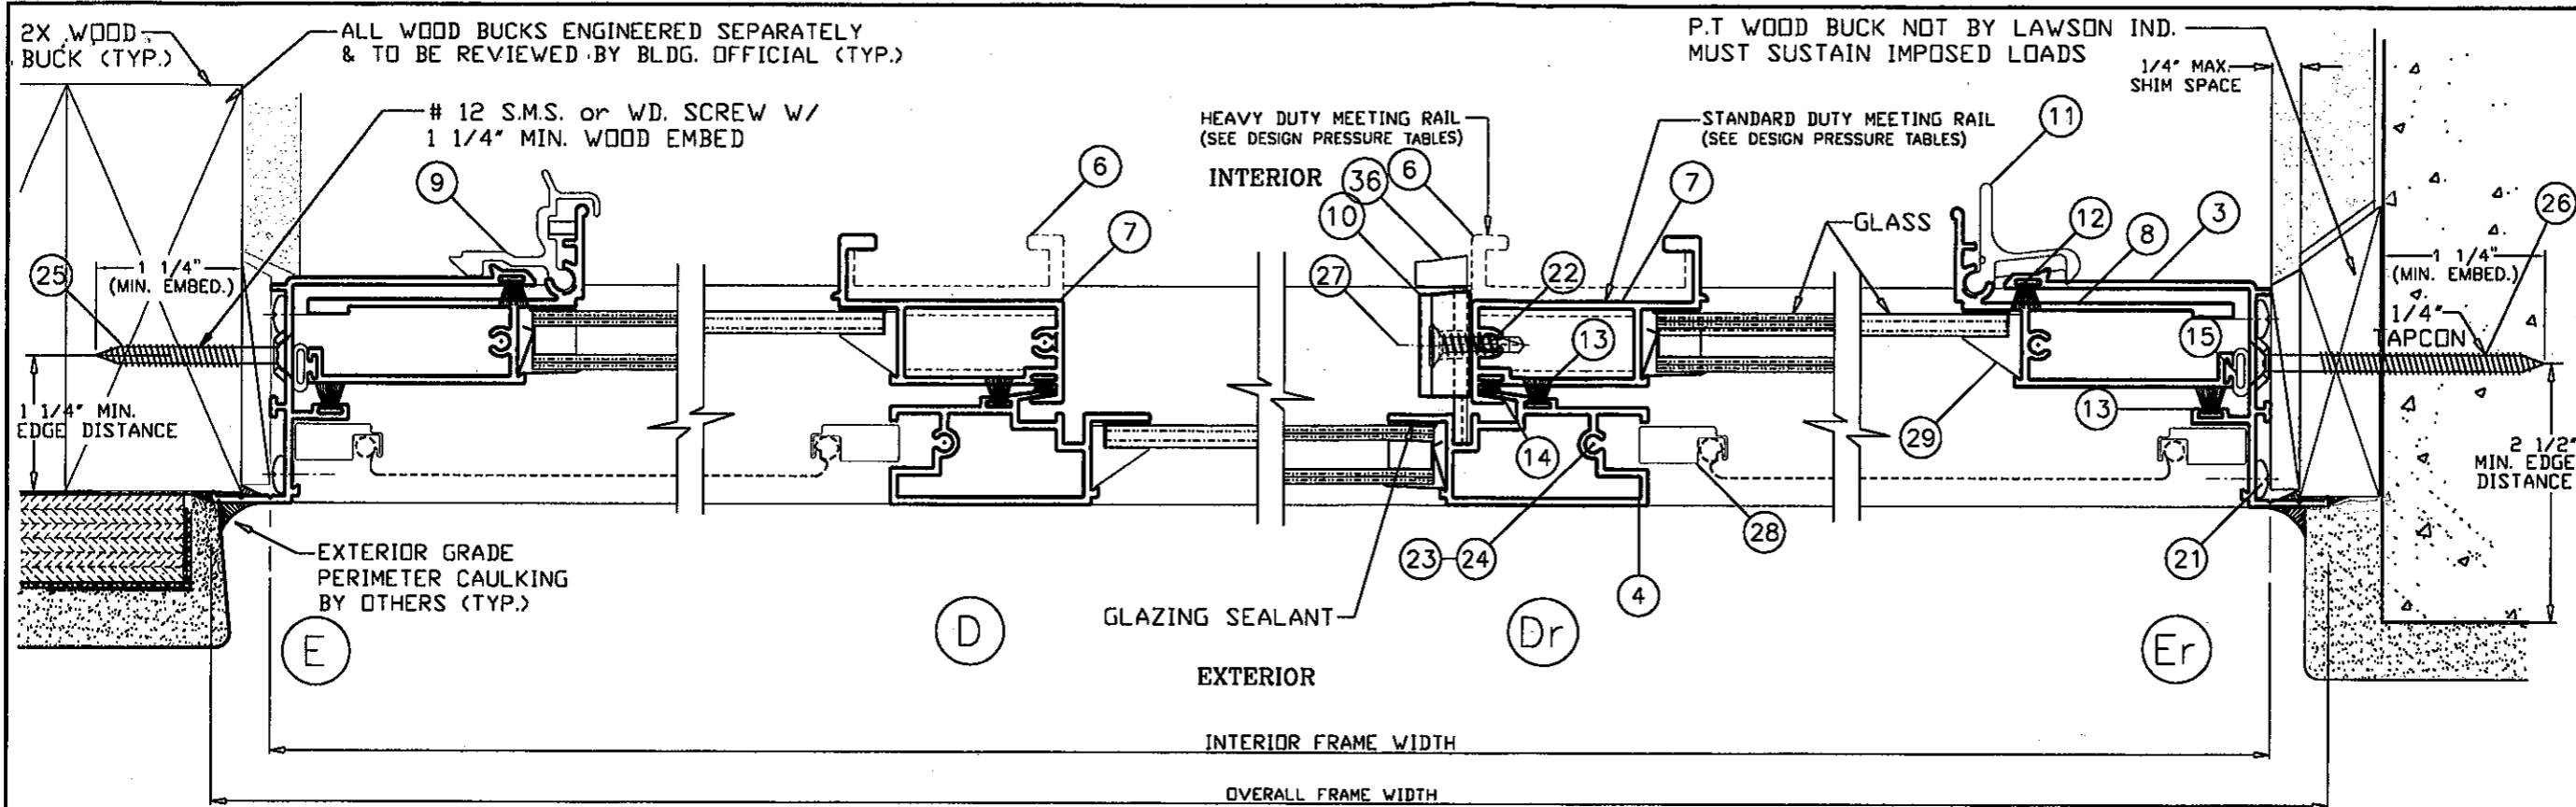

ANCHORS NOTE:
 ANCHORS TO BE #12 SMS OR WD. SCREWS INTO WOOD, OR 1/4" TAPCONS or APPROVED CONC. FASTENERS INTO CONC., WITH A MINIMUM OF 1 1/4" PENETRATION INTO WOOD OR CONC. (REFER TO LOAD TABLES FOR QUANTITIES REQUIRED)

* WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 10-1025-04
 Expiration Date JAN. 26, 2016
 By *Manuel Perez*
 Miami Dade Product Control
 Division


LAWSON INDUSTRIES, INC.
 MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS
 HS-8500 HORIZONTAL ROLLING FLANGE WINDOW
 HORIZONTAL CROSS SECTIONAL DETAILS FOR STD/HVY DUTY MEETING RAIL

8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

Product Reference Number: L8500-0401
 Drawing Number: L8500-0401
 Sheet: 3 OF 9
 Revision #:

Revision Notes:
 Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.


Drawn By: N. ERAZO	Date Drawn: 05/02/05
Checked By: N. ERAZO	Date Revised: 07/2/09
Revision Level:	Scale:

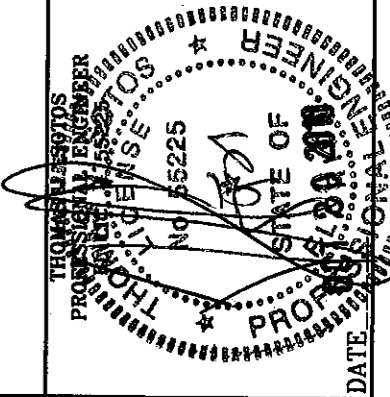

DATE

HS8500 FLANGE WINDOW - BILL OF MATERIALS


ITEM #	PART #	DRWG. #	REQD.	DESCRIPTION	REMARKS
1	L-7503	LII-127	1	FRAME HEAD	6063-T6 ALUMINUM
2	L-8501	LII-135	1	FRAME SILL	6063-T5 ALUMINUM
3	L-8502	LII-131	2	FRAME JAMB	6063-T6 ALUMINUM
4	L-7504	LII-129	2 x frame	FIXED MEETING RAIL	6005-T6 ALUMINUM
5	L-7508	LII-124	2 x vent	VENT TOP / BOTTOM RAIL	6063-T5 ALUMINUM
6	L-7506	LII-126	1 x vent	VENT INTERLOCK RAIL-H.D.	6005-T6 ALUMINUM
7	L-7505	LII-125	1 x vent	VENT INTERLOCK STD. DUTY	6005-T5 ALUMINUM
8	L-7507	LII-136	1 x vent	VENT LATCH JAMB	6005-T6 ALUMINUM
9	*	LII-012	2 x vent	VENT EXTRUDED LOCK	6063-T5 ALUMINUM
10	*	*	*	VENT CAM LOCK	DIE-CAST CAM LOCK
11	*	*	2 x vent	VENT PLASTIC LOCK	SPRING LOADED
12	*	SCHLEGEL	AS REQD.	Top/Bott. Rail Weatherstrip	.187" X .280" FIN SEAL
13	*	ULTRAFAB	AS REQD.	FXD. RAIL WEATHERSTRIP	.187" X 250" FIN SEAL
14	*	ULTRAFAB	AS REQD.	VENT LOCK WEATHERSTRIP	.187" X 150" PILE
15	*	*	AS REQ'D.	VENT JAMB WEATHERSTRIP	3/8" DIA. BULB
16	*	*	2	WEEP HOLE COVER W/ FLAP	1 1/2" wide x 1/4" hi weep
17	*	*	2	SILL OPEN CELL FOAM PAD	1/2"x3/8"x 1 3/4" LONG
18	*	*	2	SILL/JAMB JOINT GASKET	1/16" CLOSED CELL FOAM
19	L-763	HC-032	2	VENT ROLLER ASSEMBLY	2 X VENT BOTTOM RAIL
20	L-7524	*	6	VENT FACE GUIDE	3 PER VENT HOR. RAIL
21	*	*	8	FRAME ASSEMBLY SCREWS	# 8 X 5/8" P.H. PHIL.
22	*	*	4 x vent	VENT ASSEMBLY SCREWS	# 8 X 1" P.H. PHILLIPS
23	*	*	1 X RAIL	MTG. RAIL SCREW @ HEAD	# 8 X 1" P.H. PHILLIPS
24	*	*	1 X RAIL	MTG. RAIL SCREW @ SILL	# 8 X 2" P.H. PHILLIPS
25	*	*	SEE CHART	FRAME INSTALL'N SCREW	#12 X 1 1/2" F.H.-PHI.-S.M.S
26	*	*	SEE CHART	FRAME INSTALL'N SCREW	1/4" X 1 3/4" F.H.-TAPCON
27	*	*	2 X LOCK	CAM LOCK ATTCH'NT SCREW	#8 X 7/8" F.H. / PHI.
28	*	*	1 x vent	INSECT SCREEN	*
29	L-7515/16	*	AS REQD.	GLAZING BEAD	ROLL FORMED ALUMINUM
30	*	*	AS REQ'D.	GLASS	See Detail @ sheet 4 of 8
31	*	*	AS REQ'D	GLAZING SILICONE	See Detail @ sheet 4 of 8
32	L-5108	LII-111	1x anchor	SILL ANCHOR CLIP- 2"Long	6063-T6 ALUMINUM
33	*	*	5	FRAME SILL INST'N SCREW	#12 X 1 3/4" F.H. / PHI.
34	L-8503	LII-132	1	FRAME SILL 1/2" RISER	6063-T6 ALUMINUM
35	*	774-25B-767	AS REQ'D	"TruSeal" Swiggle Seal	Black -1/4" air space
36	HC-058-1		2	VENT SWEEP LATCH	MOLDED NYLON

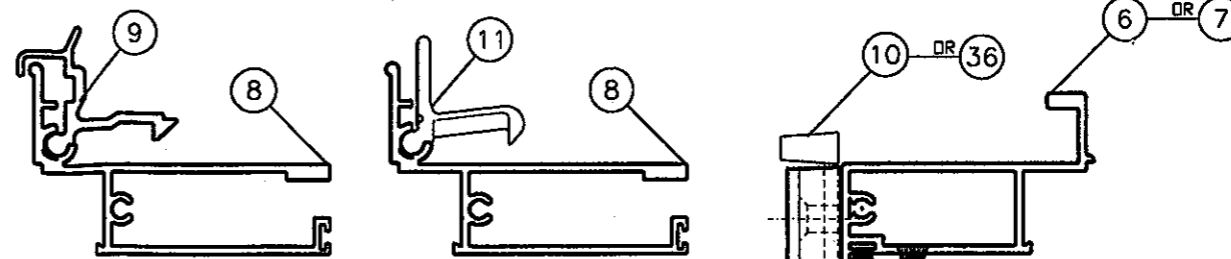

Notes

- BOTH EXTRUDED ALUMINUM AND PLASTIC LIFT HANDLE LOCKS ARE QUALIFIED FOR USE ON ALL WINDOWS.
- BOTH DIE CAST METAL AND MOLDED PLASTIC CAM LOCKS ARE QUALIFIED FOR USE ON ALL WINDOWS
- TWO (2) LOCKS ARE REQUIRED PER EACH VENT.

LOCK (LATCH AND SWEEP) OPTIONS

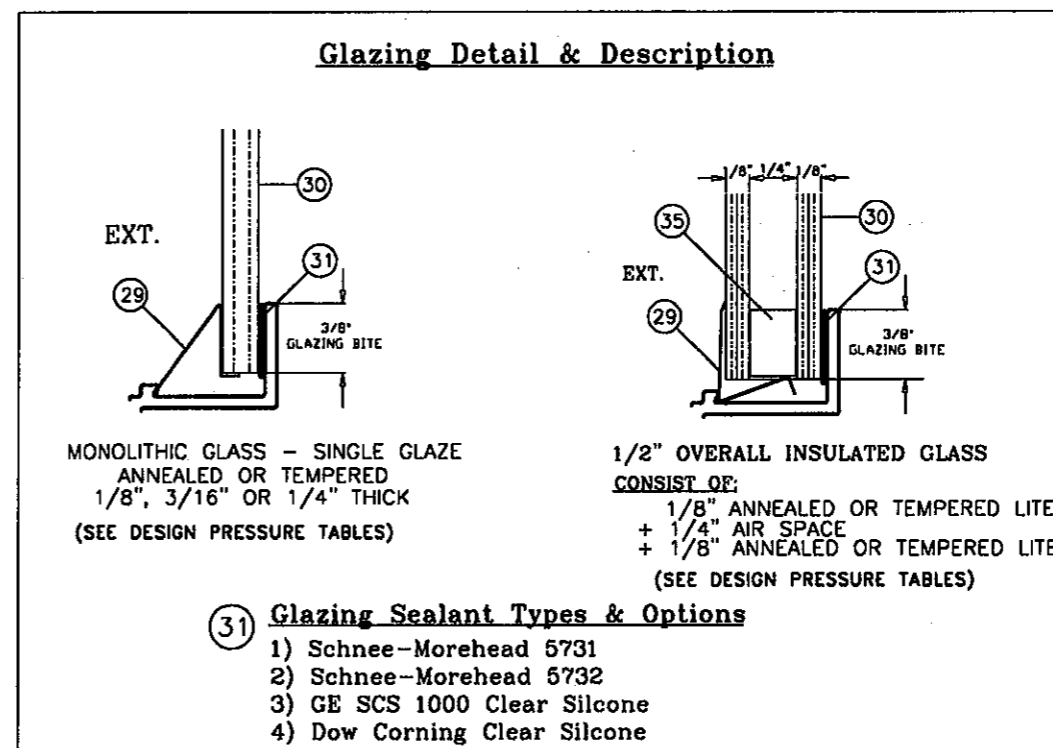

LAWSON INDUSTRIES, INC.

8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660


MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

HS-8500 HORIZONTAL ROLLING FLANGE WINDOW
BILL OF MATERIALS, GLAZING DETAILS & LOCK OPTIONS

Product Reference Number: L8500-0401 Drawing Number: 18500-0401 Sheet: 4 OF 9 Revison #: 18500-0401

Revision Notes: Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.	Date Drawn:	05/02/05
	Date Revised:	07/2/09
Drawn By:	N. ERAZO	Scale:
Checked By:	N. ERAZO	Revision Level:

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 10-1025-04
Expiration Date JAN. 26, 2016
By *Manuel Perez*
Miami Trade Product Control
Division

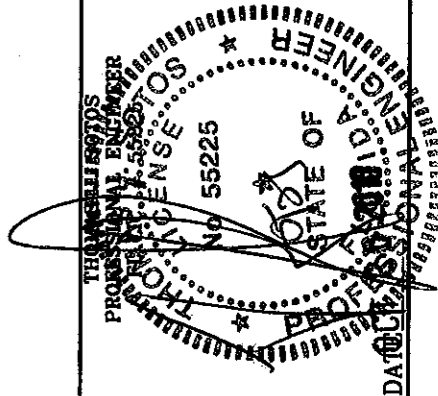

8500 Non Impact Horizontal Sliding Window Test # FTL 4413 - 1/4" Annealed Flange Frame (XO or OX) w/ HEAVY DUTY MEETING RAIL & STANDARD SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	60.0	100.0	2	2
37	26	60.0	100.0	2	2
53.125	26	60.0	100.0	3	2
74	26	60.0	100.0	5	2
26.5	38.375	60.0	100.0	2	2
37	38.375	60.0	100.0	3	2
53.125	38.375	60.0	100.0	4	2
74	38.375	60.0	100.0	6	2
26.5	50.625	60.0	100.0	2	2
37	50.625	60.0	100.0	3	2
53.125	50.625	60.0	89.6	4	3
74	50.625	60.0	74.8	5	3
26.5	58	60.0	100.0	3	2
37	58	60.0	98.6	4	3
53.125	58	60.0	74.9	4	3
74	58	60.0	60.8	5	3
26.5	63	60.0	100.0	3	2
37	63	60.0	89.4	3	3
53.125	63	60.0	67.3	4	3
74	63	54.0	54.0	5	3
24	24	60.0	100.0	2	2
36	24	60.0	100.0	2	2
48	24	60.0	100.0	3	2
60	24	60.0	100.0	3	2
72	24	60.0	100.0	4	2
24	36	60.0	100.0	2	2
36	36	60.0	100.0	3	2
48	36	60.0	100.0	3	2
60	36	60.0	100.0	4	2
72	36	60.0	100.0	5	2
24	48	60.0	100.0	2	2
36	48	60.0	100.0	3	2
48	48	60.0	100.0	4	3
60	48	60.0	89.8	5	3
72	48	60.0	82.3	5	3
24	60	60.0	100.0	2	2
36	60	60	96.9	4	3
48	60	60	77.2	4	3
60	60	60	65.9	4	3
72	60	58.8	58.8	5	3

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4413 - 1/4" Annealed Flange Frame (XO or OX) w/ HEAVY DUTY MEETING RAIL & H-RISE SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	73.3	100.0	2	2
37	26	73.3	100.0	2	2
53.125	26	73.3	100.0	3	2
74	26	73.3	100.0	5	2
26.5	38.375	73.3	100.0	2	2
37	38.375	73.3	100.0	3	2
53.125	38.375	73.3	100.0	4	2
74	38.375	73.3	100.0	6	2
26.5	50.625	73.3	100.0	2	2
37	50.625	73.3	100.0	3	2
53.125	50.625	73.3	89.6	4	3
74	50.625	73.3	74.8	5	3
26.5	58	73.3	100.0	3	2
37	58	73.3	98.6	4	3
53.125	58	73.3	74.9	4	3
74	58	60.8	60.8	5	3
26.5	63	73.3	100.0	3	2
37	63	73.3	89.4	3	3
53.125	63	67.3	67.3	4	3
74	63	54.0	54.0	5	3
24	24	73.3	100.0	2	2
36	24	73.3	100.0	2	2
48	24	73.3	100.0	3	2
60	24	73.3	100.0	3	2
72	24	73.3	100.0	4	2
24	36	73.3	100.0	2	2
36	36	73.3	100.0	3	2
48	36	73.3	100.0	3	2
60	36	73.3	100.0	4	2
72	36	73.3	100.0	5	2
24	48	73.3	100.0	2	2
36	48	73.3	100.0	3	2
48	48	73.3	100.0	4	3
60	48	73.3	89.8	5	3
72	48	73.3	82.3	5	3
24	60	73.3	100.0	2	2
36	60	73.3	96.9	4	3
48	60	73.3	77.2	4	3
60	60	65.9	65.9	4	3
72	60	58.8	58.8	5	3

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4456 - 3/16" Annealed Flange Frame (XO or OX) w/ HEAVY DUTY MEETING RAIL & STANDARD SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	60.0	100.0	2	2
37	26	60.0	100.0	2	2
53.125	26	60.0	100.0	3	2
74	26	60.0	100.0	5	2
26.5	38.375	60.0	100.0	2	2
37	38.375	60.0	100.0	3	2
53.125	38.375	60.0	100.0	4	2
74	38.375	60.0	83.8	5	2
26.5	50.625	60.0	100.0	2	2
37	50.625	60.0	100.0	3	2
53.125	50.625	60.0	77.0	4	2
74	50.625	60.0	63.6	5	2
26.5	58	60.0	100.0	3	2
37	58	60.0	88.7	3	3
53.125	58	60.0	67.1	4	2
74	58	53.7	53.7	4	3
26.5	63	60.0	100.0	3	2
37	63	60.0	80.5	3	2
53.125	63	60.0	60.6	4	2
74	63	48.3	48.3	4	2
24	24	60.0	100.0	2	2
36	24	60.0	100.0	2	2
48	24	60.0	100.0	3	2
60	24	60.0	100.0	3	2
72	24	60.0	100.0	4	2
24	36	60.0	100.0	2	2
36	36	60.0	100.0	3	2
48	36	60.0	100.0	3	2
60	36	60.0	94.8	4	2
72	36	60.0	88.1	5	2
24	48	60.0	100.0	2	2
36	48	60.0	100.0	3	2
48	48	60.0	89.7	4	2
60	48	60.0	76.0	4	2
72	48	60.0	69.5	5	2
24	60	60.0	100.0	2	2
36	60	60	87.2	3	3
48	60	60	69.5	3	2
60	60	56.7	56.7	4	2
72	60	51.6	51.6	4	2

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4456 - 3/16" Annealed Flange Frame (XO or OX) w/ HEAVY DUTY MEETING RAIL & H-RISE SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	73.3	100.0	2	2
37	26	73.3	100.0	2	2
53.125	26	73.3	100.0	3	2
74	26	73.3	100.0	5	2
26.5	38.375	73.3	100.0	2	2
37	38.375	73.3	100.0	3	2
53.125	38.375	73.3	100.0	4	2
74	38.375	73.3	83.8	5	2
26.5	50.625	73.3	100.0	2	2
37	50.625	73.3	100.0	3	2
53.125	50.625	73.3	77.0	4	2
74	50.625	63.6	63.6	5	2
26.5	58	73.3	100.0	3	2
37	58	73.3	88.7	3	2
53.125	58	67.1	67.1	4	2
74	58	53.7	53.7	4	2
26.5	63	73.3	100.0	3	2
37	63	73.3	80.5	3	2
53.125	63	60.6	60.6	4	2
74	63	48.3	48.3	4	2
24	24	73.3	100.0	2	2
36	24	73.3	100.0	2	2
48	24	73.3	100.0	3	2
60	24	73.3	100.0	3	2
72	24	73.3	100.0	4	2
24	36	73.3	100.0	2	2
36	36	73.3	100.0	3	2
48	36	73.3	100.0	3	2
60	36	73.3	94.8	4	2
72	36	73.3	88.1	5	2
24	48	73.3	100.0	2	2
36	48	73.3	100.0	3	2
48	48	73.3	89.7	4	2
60	48	73.3	76.0	4	2
72	48	69.5	69.5	5	2
24	60	73.3	100.0	2	2
36	60	73.3	87.2	3	3
48	60	69.5	69.5	3	2
60	60	56.7	56.7	4	2
72	60	51.6	51.6	4	2

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4553 - 3/16" Annealed Flange Frame (XO or OX) w/ STANDARD MEETING RAIL & STANDARD SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	60.0	100.0	2	2
37	26	60.0	100.0	2	2
53.125	26	60.0	100.0	3	2
74	26	60.0	100.0	5	2
26.5	38.375	60.0	100.0	2	2
37	38.375	60.0	100.0	3	2
53.125	38.375	60.0	83.8	4	2
74	38.375	60.0	76.0	5	2
26.5	50.625	60.0	95.8	2	2
37	50.625	60.0	73.0	3	2
53.125	50.625	56.3	56.3	3	2
74	50.625	47.0	47.0	4	2
24	24	60.0	100.0	2	2
36	24	60.0	100.0	2	2
48	24	60.0	100.0	3	2
60	24	60.0	100.0	3	2
72	24	60.0	100.0	4	2
24	36	60.0	100.0	2	2
36	36	60.0	100.0	3	2
48	36	60.0	97.0	3	2
60	36	60.0	88.7	4	2
72	36	60.0	88.2	5	2
24	48	60.0	100.0	2	2
36	48	60.0	79.6	3	2
48	48	60.0	64.7	3	2
60	48	56.4	56.4	3	2
72	48	51.7	51.7	4	2

Pressure Limited to Negative 100psf.


8500 Non Impact Horizontal Sliding Window Test # FTL 4553 - 3/16" Annealed Flange Frame (XO or OX) w/ STANDARD MEETING RAIL & H-RISE SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	73.3	100.0	2	2
37	26	73.3	100.0	2	2
53.125	26	73.3	100.0	3	2
74	26	73.3	100.0	5	2
26.5	38.375	73.3	100.0	2	2
37	38.375	73.3	100.0	3	2
53.125	38.375	73.3	83.8	4	2
74	38.375	73.3	76.0	5	2
26.5	50.625	73.3	95.8	2	2
37	50.625	73.0	73.0	3	2
53.125	50.625	56.3	56.3	3	2
74	50.625	47.0	47.0	4	2
24	24	73.3	100.0	2	2
36	24	73.3	100.0	2	2
48	24	73.3	100.0	3	2
60	24	73.3	100.0	3	2
72	24	73.3	100.0	4	2
24	36	73.3	100.0	2	2
36	36	73.3	100.0	3	2
48	36	73.3	97.0	3	2
60	36	73.3	88.7	4	2
72	36	73.3	86.2	5	2
24	48	73.3	100.0	2	

8500 Non Impact Horizontal Sliding Window (XO Or OX)					
Test # HETI-08-2158 thru 08-2160 - 1/8" Tempered Flange Frame					
w/ HEAVY DUTY MEETING RAIL & STANDARD SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	60.0	100.0	2	2
37	26	60.0	100.0	2	2
53.125	26	60.0	100.0	3	2
74	26	60.0	100.0	5	2
26.5	38.375	60.0	100.0	2	2
37	38.375	60.0	100.0	3	2
53.125	38.375	60.0	100.0	4	2
74	38.375	60.0	100.0	6	2
26.5	50.625	60.0	100.0	2	2
37	50.625	60.0	100.0	3	2
53.125	50.625	60.0	93.0	4	3
74	50.625	60.0	77.6	5	3
26.5	58	60.0	100.0	3	2
37	58	60.0	100.0	4	3
53.125	58	60.0	77.6	4	3
74	58	60.0	63.1	5	3
26.5	63	60.0	100.0	3	2
37	63	60.0	92.7	4	3
53.125	63	60.0	69.8	4	3
74	63	56.0	56.0	5	3
24	24	60.0	100.0	2	2
36	24	60.0	100.0	2	2
48	24	60.0	100.0	3	2
60	24	60.0	100.0	3	2
72	24	60.0	100.0	4	2
24	36	60.0	100.0	2	2
36	36	60.0	100.0	3	2
48	36	60.0	100.0	3	2
60	36	60.0	100.0	4	2
72	36	60.0	100.0	5	2
24	48	60.0	100.0	2	2
36	48	60.0	100.0	3	2
48	48	60.0	100.0	4	3
60	48	60.0	93.1	5	3
72	48	60.0	85.4	6	3
24	60	60.0	100.0	2	2
36	60	60.0	100.0	4	3
48	60	60.0	80.0	4	3
60	60	60.0	68.3	4	3
72	60	60.0	61.0	5	3

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window (XO Or OX)					
Test # HETI-08-2158 thru 08-2160 - 1/8" Tempered Flange Frame					
w/ HEAVY DUTY MEETING RAIL & HI-RISE SILL					
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors	
				Head & Sill	Each Jamb
26.5	26	73.3	100.0	2	2
37	26	73.3	100.0	2	2
53.125	26	73.3	100.0	3	2
74	26	73.3	100.0	5	2
26.5	38.375	73.3	100.0	2	2
37	38.375	73.3	100.0	3	2
53.125	38.375	73.3	100.0	4	2
74	38.375	73.3	100.0	6	2
26.5	50.625	73.3	100.0	2	2
37	50.625	73.3	100.0	3	2
53.125	50.625	73.3	93.0	4	3
74	50.625	73.3	77.6	5	3
26.5	58	73.3	100.0	3	2
37	58	73.3	100.0	4	3
53.125	58	73.3	77.6	4	3
74	58	63.1	63.1	5	3
26.5	63	73.3	100.0	3	2
37	63	73.3	92.7	4	3
53.125	63	69.8	69.8	4	3
74	63	56.0	56.0	5	3
24	24	73.3	100.0	2	2
36	24	73.3	100.0	2	2
48	24	73.3	100.0	3	2
60	24	73.3	100.0	3	2
72	24	73.3	100.0	4	2
24	36	73.3	100.0	2	2
36	36	73.3	100.0	3	2
48	36	73.3	100.0	3	2
60	36	73.3	100.0	4	2
72	36	73.3	100.0	5	2
24	48	73.3	100.0	2	2
36	48	73.3	100.0	3	2
48	48	73.3	100.0	4	3
60	48	73.3	93.1	5	3
72	48	73.3	85.4	6	3
24	60	73.3	100.0	2	2
36	60	73.3	100.0	4	3
48	60	73.3	80.0	4	3
60	60	68.3	68.3	4	3
72	60	61.0	61.0	5	3


Pressure Limited to Negative 100psf.



MONOLITHIC GLASS - SINGLE GLAZE
 ANNEALED OR TEMPERED
 1/8", 3/16" OR 1/4" THICK
 (SEE DESIGN PRESSURE TABLES)

GLAZING DETAIL & DESCRIPTION


- Note:
1. WINDOW WIDTHS & HEIGHTS ARE THE OVERALL EXTERIOR FRAME DIMENSIONS.

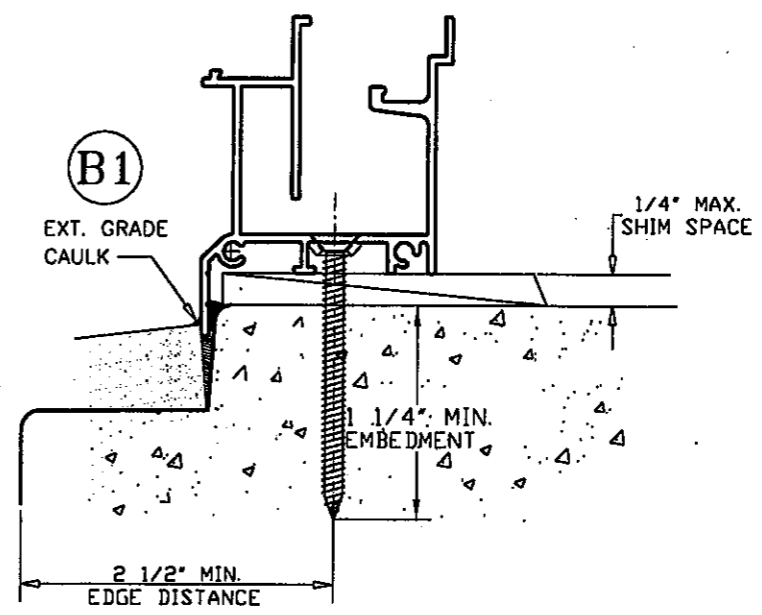

OPTIONAL SILL INSTALLATION DETAIL

ANCHORS NOTE:
 ANCHORS TO BE #12 SMS OR WD. SCREWS INTO WOOD, OR 1/4" TAPCONS OR APPROVED CONC. FASTENERS INTO CONC., WITH A MINIMUM OF 1 1/4" PENETRATION INTO WOOD OR CONC. (REFER TO LOAD TABLES FOR QUANTITIES REQUIRED)

* WHEN THE GAP BETWEEN THE WINDOW FRAME AND THE BUCK OR MASONRY IS LESS THAN 1/8", SHIMS ARE NOT REQUIRED.

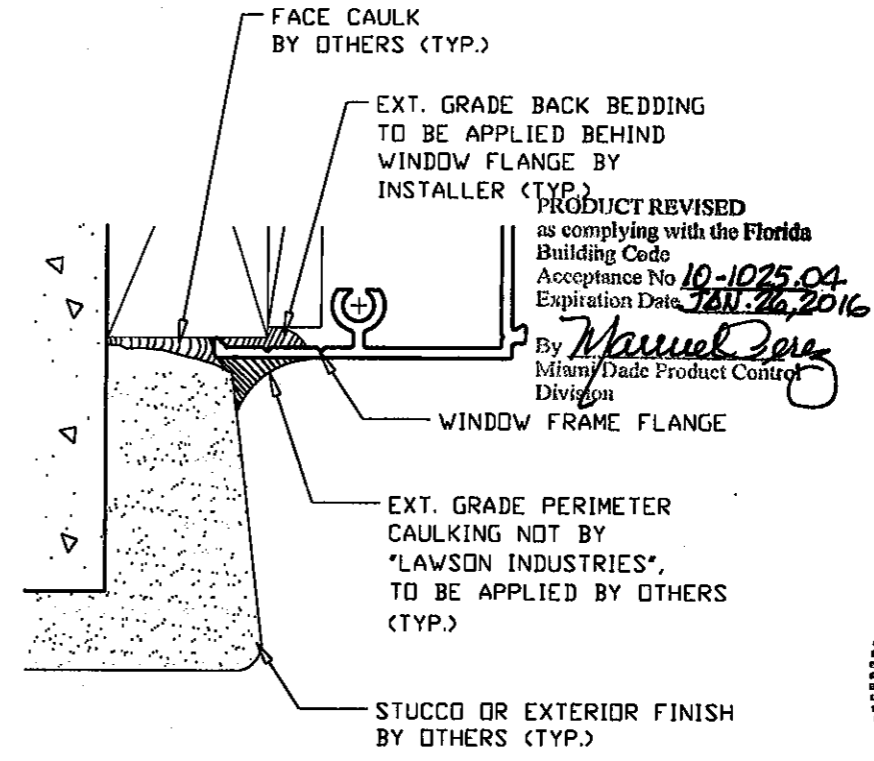

WINDOW INSTALLATION DETAIL


8501 N.W. 90 ST.
 MEDLEY, FLORIDA 33166
 PH No. (305) 696-8660

LAWSON
 INDUSTRIES, INC.

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

HS-8500 HORIZONTAL ROLLING FLANGE WINDOW
 GLASS LOAD CHARTS, GLAZING DETAIL, OPTIONAL INSTALLATION DETAIL

Revision Notes: Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.	Date Drawn: 05/02/05
Drawn By: N. ERAZO	Date Revised: 07/2/08
Checked By: N. ERAZO	Scale:
Revision Level:	

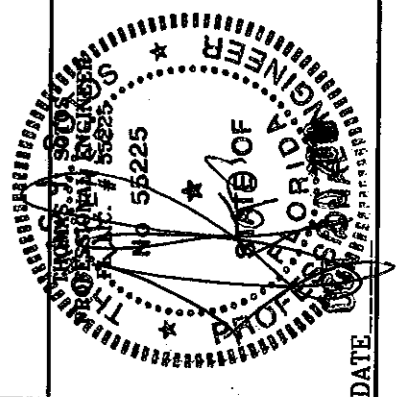

DATE

8500 Non Impact Horizontal Sliding Window Test # FTL 4429 - 1/4" Annealed Flange Frame (XOX) w/ HEAVY DUTY MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
106.375	26	60.0	100.0	7	2	
111	26	60.0	100.0	7	2	
53.125	38.375	60.0	100.0	4	2	
74	38.375	60.0	100.0	6	2	
106.375	38.375	60.0	76.9	7	2	
111	38.375	60.0	73.1	7	2	
53.125	50.625	60.0	100.0	6	2	
74	50.625	60.0	81.9	6	2	
106.375	50.625	60.0	65.0	7	2	
111	50.625	60.0	61.9	7	2	
53.125	58	60.0	90.8	6	2	
74	58	60.0	70.3	6	2	
106.375	58	57.2	57.2	7	2	
111	58	55.5	55.5	8	2	
53.125	63	60.0	82.1	6	2	
74	63	60.0	62.5	6	2	
106.375	63	52.1	52.1	7	2	
111	63	51.1	51.1	8	2	
72	24	60.0	100.0	4	2	
84	24	60.0	100.0	5	2	
96	24	60.0	100.0	6	2	
108	24	60.0	100.0	6	2	
120	24	60.0	100.0	7	2	
72	36	60.0	100.0	6	2	
84	36	60.0	94.4	6	2	
96	36	60.0	87.0	7	2	
108	36	60.0	78.6	7	2	
120	36	60.0	68.5	7	2	
72	48	60.0	87.2	6	2	
84	48	60.0	80.3	7	2	
96	48	60.0	74.3	7	2	
108	48	60.0	66.4	7	2	
120	48	59.3	59.3	8	2	
72	60	60.0	69.2	6	2	
84	60	60.0	61.5	6	2	
96	60	58.6	58.6	7	2	
108	60	54.8	54.8	8	2	
120	60	51	51	8	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4429 - 1/4" Annealed Flange Frame (XOX) w/ HEAVY DUTY MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
106.375	26	73.3	100.0	7	2	
111	26	73.3	100.0	7	2	
53.125	38.375	73.3	100.0	4	2	
74	38.375	73.3	100.0	6	2	
106.375	38.375	73.3	76.9	7	2	
111	38.375	73.1	73.1	7	2	
53.125	50.625	73.3	100.0	6	2	
74	50.625	73.3	81.9	6	2	
106.375	50.625	65.0	65.0	7	2	
111	50.625	61.9	61.9	7	2	
53.125	58	73.3	90.8	6	2	
74	58	70.3	70.3	6	2	
106.375	58	57.2	57.2	7	2	
111	58	55.5	55.5	8	2	
53.125	63	73.3	82.1	6	2	
74	63	62.5	62.5	6	2	
106.375	63	52.1	52.1	7	2	
111	63	51.1	51.1	8	2	
72	24	73.3	100.0	4	2	
84	24	73.3	100.0	5	2	
96	24	73.3	100.0	6	2	
108	24	73.3	100.0	6	2	
120	24	73.3	100.0	7	2	
72	36	73.3	100.0	6	2	
84	36	73.3	94.4	6	2	
96	36	73.3	87.0	7	2	
108	36	73.3	78.6	7	2	
120	36	68.5	68.5	7	2	
72	48	73.3	87.2	6	2	
84	48	73.3	80.3	7	2	
96	48	73.3	74.3	7	2	
108	48	66.4	66.4	7	2	
120	48	59.3	59.3	8	2	
72	60	69.2	69.2	6	2	
84	60	61.5	61.5	6	2	
96	60	58.6	58.6	7	2	
108	60	54.8	54.8	8	2	
120	60	51	51	8	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4457 - 3/16" Annealed Flange Frame (XOX) w/ HEAVY DUTY MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
106.375	26	60.0	81.6	5	2	
111	26	60.0	79.0	5	2	
53.125	38.375	60.0	100.0	4	2	
74	38.375	60.0	86.0	5	2	
106.375	38.375	60.0	61.6	6	2	
111	38.375	58.7	58.7	6	2	
53.125	50.625	60.0	86.5	5	2	
74	50.625	60.0	65.7	5	2	
106.375	50.625	52.3	52.3	6	2	
111	50.625	50.3	50.3	6	2	
53.125	58	60.0	79.4	5	2	
74	58	54.6	54.6	5	2	
106.375	58	46.5	46.5	6	2	
111	58	44.9	44.9	6	2	
53.125	63	60.0	72.0	5	2	
74	63	49.2	49.2	5	2	
106.375	63	42.9	42.9	6	2	
111	63	41.3	41.3	6	2	
72	24	60.0	100.0	4	2	
84	24	60.0	100.0	5	2	
96	24	60.0	95.3	5	2	
108	24	60.0	90.5	6	2	
120	24	60.0	85.3	6	2	
72	36	60.0	91.2	5	2	
84	36	60.0	82.0	5	2	
96	36	60.0	74.2	6	2	
108	36	60.0	62.0	6	2	
120	36	53.3	53.3	6	2	
72	48	60.0	71.3	5	2	
84	48	60.0	65.8	6	2	
96	48	60.0	60.0	6	2	
108	48	53.7	53.7	6	2	
120	48	48.7	48.7	6	2	
72	60	52.6	52.6	5	2	
84	60	50.7	50.7	6	2	
96	60	48.3	48.3	6	2	
108	60	44.5	44.5	6	2	
120	60	40.8	40.8	7	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4457 - 3/16" Annealed Flange Frame (XOX) w/ HEAVY DUTY MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
106.375	26	73.3	81.6	5	2	
111	26	73.3	79.0	5	2	
53.125	38.375	73.3	100.0	4	2	
74	38.375	73.3	86.0	5	2	
106.375	38.375	61.6	61.6	6	2	
111	38.375	58.7	58.7	6	2	
53.125	50.625	73.3	86.5	5	2	
74	50.625	65.7	65.7	5	2	
106.375	50.625	52.3	52.3	6	2	
111	50.625	50.3	50.3	6	2	
53.125	58	73.3	79.4	5	2	
74	58	54.6	54.6	5	2	
106.375	58	46.5	46.5	6	2	
111	58	44.9	44.9	6	2	
53.125	63	72.0	72.0	5	2	
74	63	49.2	49.2	5	2	
106.375	63	42.9	42.9	6	2	
111	63	41.3	41.3	6	2	
72	24	73.3	100.0	4	2	
84	24	73.3	100.0	5	2	
96	24	73.3	95.3	5	2	
108	24	73.3	90.5	6	2	
120	24	73.3	85.3	6	2	
72	36	73.3	91.2	5	2	
84	36	73.3	82.0	5	2	
96	36	73.3	74.2	6	2	
108	36	62.0	62.0	6	2	
120	36	53.3	53.3	6	2	
72	48	71.3	71.3	5	2	
84	48	65.8	65.8	6	2	
96	48	60.0	60.0	6	2	
108	48	53.7	53.7	6	2	
120	48	48.7	48.7	6	2	
72	60	52.6	52.6	5	2	
84	60	50.7	50.7	6	2	
96	60	48.3	48.3	6	2	
108	60	44.5	44.5	6	2	
120	60	40.8	40.8	7	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4594 - 3/16" Annealed Flange Frame (XOX) w/ STANDARD MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
106.375	26	60.0	81.6	5	2	
111	26	60.0	79.0	5	2	
53.125	38.375	60.0	92.2	4	2	
74	38.375	60.0	79.6	5	2	
106.375	38.375	60.0	61.6	6	2	
111	38.375	58.7	58.7	6	2	
53.125	50.625	60.0	64.3	4	2	
74	50.625	51.9	51.9	4	2	
106.375	50.625	44.6	44.6	5	2	
111	50.625	44.1	44.1	5	2	
72	24	60.0	100.0	4	2	
84	24	60.0	100.0	5	2	
96	24	60.0	95.3	5	2	
108	24	60.0	90.5	6	2	
120	24	60.0	85.3	6	2	
72	36	60.0	89.4	5	2	
84	36	60.0	82.0	5	2	
96	36	60.0	74.2	6	2	
108	36	60.0	62.0	6	2	
120	36	53.3	53.3	6	2	
72	48	56.9	56.9	4	2	
84	48	52.8	52.8	5	2	
96	48	50.3	50.3	5	2	
108	48	48.7	48.7	6	2	
120	48	47.3	47.3	6	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window Test # FTL 4594 - 3/16" Annealed Flange Frame (XOX) w/ STANDARD MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
106.375	26	73.3	81.6	5	2	
111	26	73.3	79.0	5	2	
53.125	38.375	73.3	92.2	4	2	
74	38.375	73.3	79.6	5	2	
106.375	38.375	61.6	61.6	6	2	
111	38.375	58.7	58.7	6	2	
53.125	50.625	64.3	64.3	4	2	
74	50.625	51.9	51.9	4	2	
106.375	50.625	44.6	44.6	5	2	
111	50.625	44.1	44.1	5	2	
72	24	73.3	100.0	4	2	
84	24	73.3	100.0	5	2	
96	24	73.3	95.3	5	2	
108	24	73.3	90.5	6	2	
120	24	73.3	85.3	6	2	
72	36	73.3	89.4	5	2	
84	36	73.3	82.0	5	2	
96	36	73.3	74.2	6	2	
108	36	62.0	62.0	6	2	
120	36	53.3	53.3	6	2	
72	48	56.9	56.9			

8500 Non Impact Horizontal Sliding Window - XOX Test # FTL 4541 - 1/8" Annealed Insulated Flange Frame w/ HEAVYDUTY MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
106.375	26	60.0	77.4	5	2	
111	26	60.0	72.9	5	2	
53.125	38.375	60.0	100.0	4	2	
74	38.375	60.0	98.5	6	2	
106.375	38.375	60.0	69.7	6	2	
111	38.375	60.0	66.9	6	2	
53.125	50.625	60.0	80.9	5	2	
74	50.625	60.0	75.0	6	2	
106.375	50.625	53.2	53.2	6	2	
111	50.625	50.8	50.8	6	2	
53.125	58	60.0	68.1	5	2	
74	58	60.0	62.7	6	2	
106.375	58	46.1	46.1	6	2	
111	58	44.3	44.3	6	2	
53.125	63	60.0	61.8	4	2	
74	63	56.2	56.2	6	2	
106.375	63	42.8	42.8	6	2	
111	63	40.9	40.9	6	2	
72	24	60.0	100.0	4	2	
84	24	60.0	100.0	5	2	
96	24	60.0	91.9	5	2	
108	24	60.0	78.8	5	2	
120	24	60.0	70.0	5	2	
72	36	60.0	100.0	6	2	
84	36	60.0	92.4	6	2	
96	36	60	81.2	6	2	
108	36	60	72	6	2	
120	36	60	63.6	6	2	
72	48	60	81.6	6	2	
84	48	60	71.5	6	2	
96	48	60.0	62.9	6	2	
108	48	55.1	55.1	6	2	
120	48	49.4	49.4	6	2	
72	60	60.0	61.0	6	2	
84	60	55.4	55.4	6	2	
96	60	49.9	49.9	6	2	
108	60	44.2	44.2	6	2	
120	60	39.6	39.6	6	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window - XOX Test # FTL 4541 - 1/8" Annealed Insulated Flange Frame w/ HEAVYDUTY MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
106.375	26	73.3	77.4	5	2	
111	26	72.9	72.9	5	2	
53.125	38.375	73.3	100.0	4	2	
74	38.375	73.3	98.5	6	2	
106.375	38.375	69.7	69.7	6	2	
111	38.375	66.9	66.9	6	2	
53.125	50.625	73.3	80.9	5	2	
74	50.625	73.3	75.0	6	2	
106.375	50.625	53.2	53.2	6	2	
111	50.625	50.8	50.8	6	2	
53.125	58	68.1	68.1	5	2	
74	58	62.7	62.7	6	2	
106.375	58	46.1	46.1	6	2	
111	58	44.3	44.3	6	2	
53.125	63	61.8	61.8	4	2	
74	63	56.2	56.2	6	2	
106.375	63	42.8	42.8	6	2	
111	63	40.9	40.9	6	2	
72	24	73.3	100.0	4	2	
84	24	73.3	100.0	5	2	
96	24	73.3	91.9	5	2	
108	24	73.3	78.8	5	2	
120	24	70.0	70.0	5	2	
72	36	73.3	100.0	6	2	
84	36	73.3	92.4	6	2	
96	36	73.3	81.2	6	2	
108	36	72.0	72.0	6	2	
120	36	63.6	63.6	6	2	
72	48	73.3	81.6	6	2	
84	48	71.5	71.5	6	2	
96	48	62.9	62.9	6	2	
108	48	55.1	55.1	6	2	
120	48	49.4	49.4	6	2	
72	60	61.0	61.0	6	2	
84	60	55.4	55.4	6	2	
96	60	49.9	49.9	6	2	
108	60	44.2	44.2	6	2	
120	60	39.6	39.6	6	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window - XO or OX Test # FTL 4533 - 1/8" Annealed Insulated Flange Frame w/ HEAVYDUTY MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
26.5	26	60.0	100.0	2	2	
37	26	60.0	100.0	2	2	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
26.5	38.375	60.0	100.0	2	2	
37	38.375	60.0	100.0	3	2	
53.125	38.375	60.0	100.0	4	2	
74	38.375	60.0	93.1	5	2	
26.5	50.625	60.0	100.0	2	2	
37	50.625	60.0	100.0	3	2	
53.125	50.625	60.0	80.3	4	3	
74	50.625	60.0	71.7	5	3	
26.5	58	60.0	100.0	3	2	
37	58	60.0	98.6	4	3	
53.125	58	60.0	66.0	4	2	
74	58	60.0	60.8	5	3	
26.5	63	60.0	100.0	3	2	
37	63	60.0	89.4	3	3	
53.125	63	57.0	57.0	4	2	
74	63	54.0	54.0	5	3	
24	24	60.0	100.0	2	2	
36	24	60.0	100.0	2	2	
48	24	60.0	100.0	3	2	
60	24	60.0	100.0	3	2	
72	24	60.0	100.0	4	2	
24	36	60.0	100.0	2	2	
36	36	60.0	100.0	3	2	
48	36	60.0	100.0	3	2	
60	36	60.0	100.0	4	2	
72	36	60.0	100.0	5	2	
24	48	60.0	100.0	2	2	
36	48	60.0	100.0	3	2	
48	48	60.0	88.3	4	2	
60	48	60.0	85.7	4	3	
72	48	60.0	77.3	5	3	
24	60	60.0	100.0	2	2	
36	60	60	96.9	4	3	
48	60	60	66.0	3	2	
60	60	60	63.1	4	3	
72	60	58.8	58.8	5	3	

Pressure Limited to Negative 100psf.














8500 Non Impact Horizontal Sliding Window - XO or OX Test # FTL 4533 - 1/8" Annealed Insulated Flange Frame w/ HEAVYDUTY MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
26.5	26	73.3	100.0	2	2	
37	26	73.3	100.0	2	2	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
26.5	38.375	73.3	100.0	2	2	
37	38.375	73.3	100.0	3	2	
53.125	38.375	73.3	100.0	4	2	
74	38.375	73.3	93.1	5	2	
26.5	50.625	73.3	100.0	2	2	
37	50.625	73.3	100.0	3	2	
53.125	50.625	73.3	80.3	4	3	
74	50.625	71.7	71.7	5	3	
26.5	58	73.3	100.0	3	2	
37	58	73.3	98.6	4	3	
53.125	58	66.0	66.0	4	2	
74	58	60.8	60.8	5	3	
26.5	63	73.3	100.0	3	2	
37	63	73.3	89.4	3	3	
53.125	63	57.0	57.0	4	2	
74	63	54.0	54.0	5	3	
24	24	73.3	100.0	2	2	
36	24	73.3	100.0	2	2	
48	24	73.3	100.0	3	2	
60	24	73.3	100.0	3	2	
72	24	73.3	100.0	4	2	
24	36	73.3	100.0	2	2	
36	36	73.3	100.0	3	2	
48	36	73.3	100.0	3	2	
60	36	73.3	100.0	4	2	
72	36	73.3	100.0	5	2	
24	48	73.3	100.0	2	2	
36	48	73.3	100.0	3	2	
48	48	73.3	88.3	4	2	
60	48	73.3	85.7	4	3	
72	48	73.3	77.3	5	3	
24	60	73.3	100.0	2	2	
36	60	73.3	96.9	4	3	
48	60	66.0	66.0	3	2	
60	60	63.1	63.1	4	3	
72	60	58.8	58.8	5	3	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window - XOX Test # FTL 4588 - 1/8" Annealed Insulated Flange Frame w/ STANDARD MEETING RAIL & STANDARD SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	60.0	100.0	3	2	
74	26	60.0	100.0	5	2	
106.375	26	60.0	77.4	5	2	
111	26	60.0	72.9	5	2	
53.125	38.375	60.0	93.2	4	2	
74	38.375	60.0	79.6	5	2	
106.375	38.375	60.0	69.7	6	2	
111	38.375	60.0	66.9	6	2	
53.125	50.625	60.0	64.3	4	2	
74	50.625	51.9	51.9	4	2	
106.375	50.625	44.6	44.6	5	2	
111	50.625	44.1	44.1	5	2	
72	24	60.0	100.0	4	2	
84	24	60.0	100.0	5	2	
96	24	60.0	91.9	5	2	
108	24	60.0	78.8	5	2	
120	24	60.0	70.0	5	2	
72	36	60.0	89.4	5	2	
84	36	60.0	85.7	6	2	
96	36	60.0	81.2	6	2	
108	36	60.0	72.0	6	2	
120	36	60.0	63.6	6	2	
72	48	56.9	56.9	4	2	
84	48	52.8	52.8	5	2	
96	48	50.3	50.3	5	2	
108	48	48.7	48.7	6	2	
120	48	47.3	47.3	6	2	

Pressure Limited to Negative 100psf.

8500 Non Impact Horizontal Sliding Window - XOX Test # FTL 4588 - 1/8" Annealed Insulated Flange Frame w/ STANDARD MEETING RAIL & HI-RISE SILL						
Width (in)	Height (in)	DP(+) psf	DP(-) psf	Anchors		
				Head & Sill	Each Jamb	
53.125	26	73.3	100.0	3	2	
74	26	73.3	100.0	5	2	
106.375	26	73.3	77.4	5	2	
111	26	72.9	72.9	5	2	
53.125	38.375	73.3	93.2	4	2	
74	38.375	73.3	79.6	5	2	
106.375	38.375	69.7	69.7	6	2	
111	38.375	66.9	66.9	6	2	
53.125	50.625	64.3	64.3	4	2	
74	50.625	51.9	51.9	4	2	
106.375	50.625	44.6	44.6	5	2	
111	50.625	44.1	44.1	5	2	
72	24	73.3	100.0	4	2	
84	24	73.3	100.0	5	2	
96	24	73.3	91.9	5	2	
108	24	73.3	78.8	5	2	
120	24	70.0	70.0	5	2	
72	36	73.3	89.4	5	2	
84	36	73.3	85.7	6	2	
96	36	73.3	81.2	6	2	
108	36	72.0	72.0	6	2	
120	36	63.6	63.6	6	2	
72	48	56.9</				

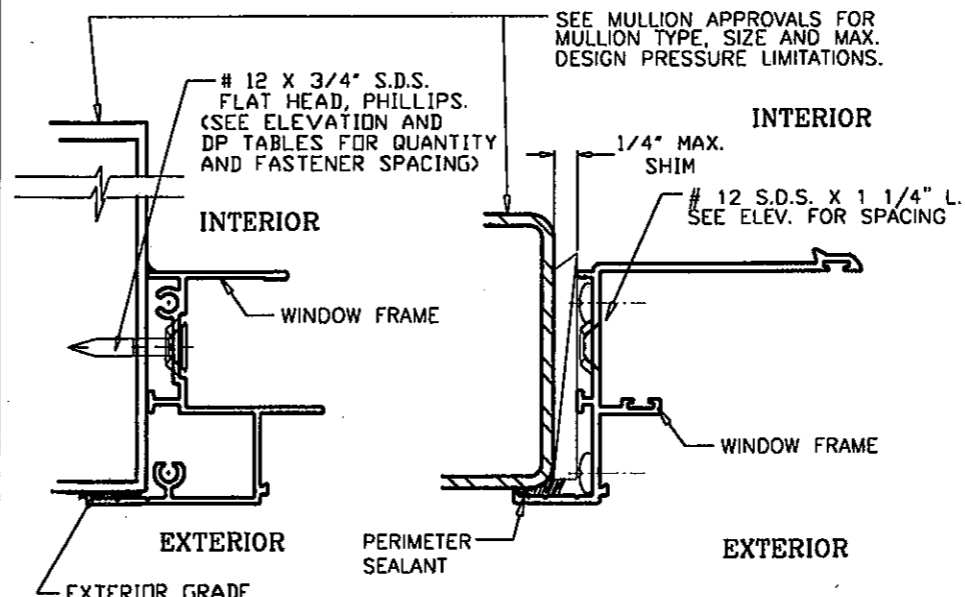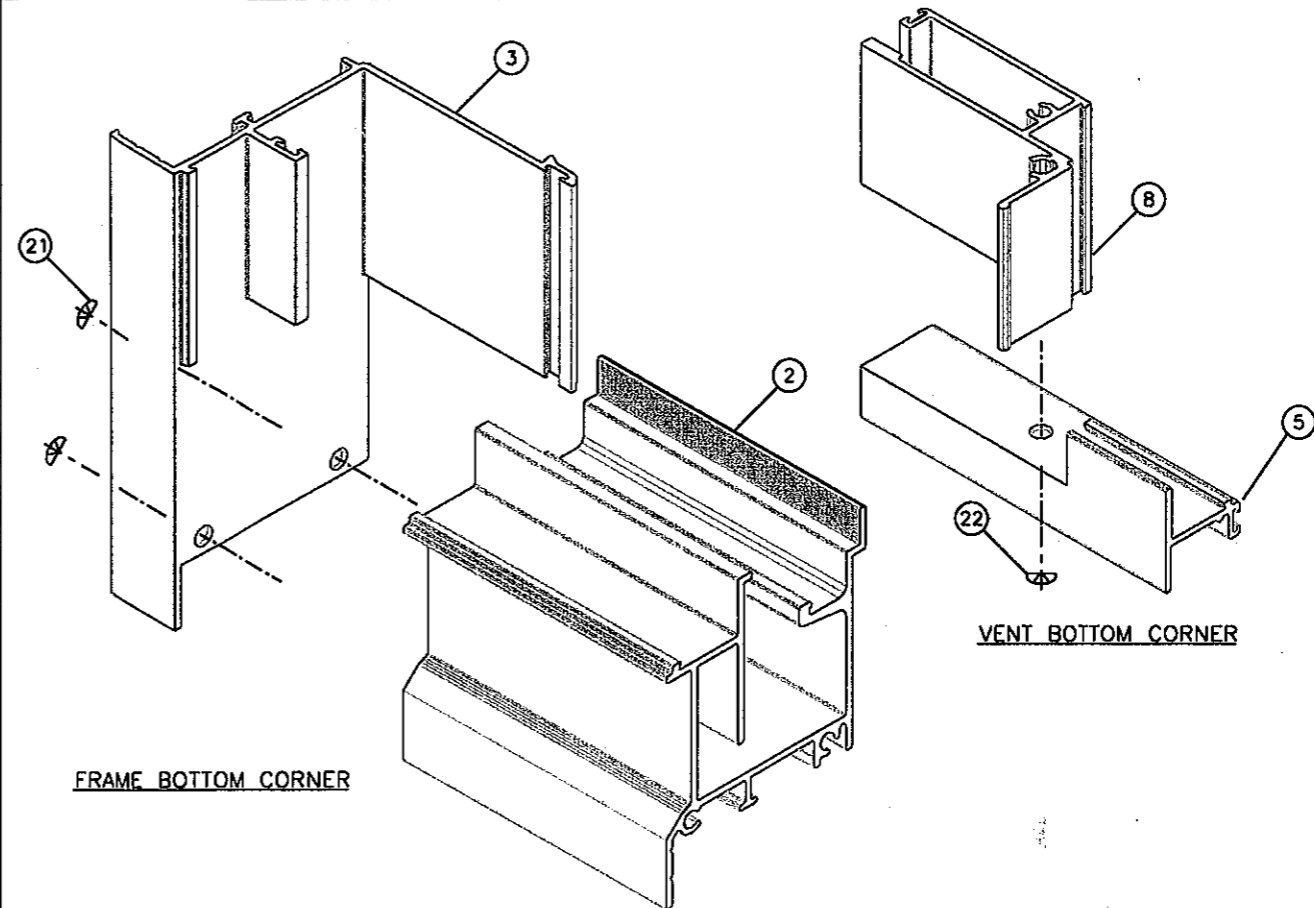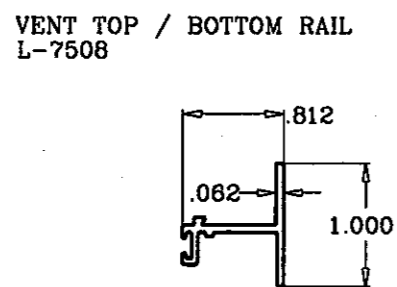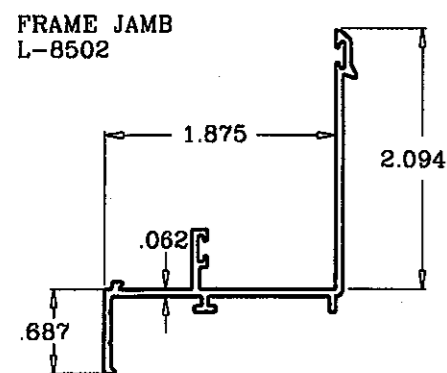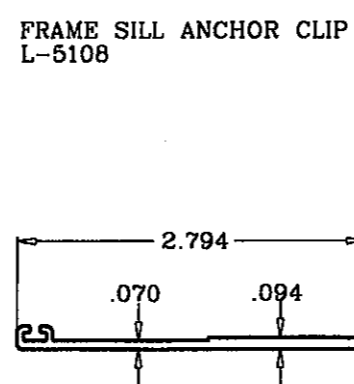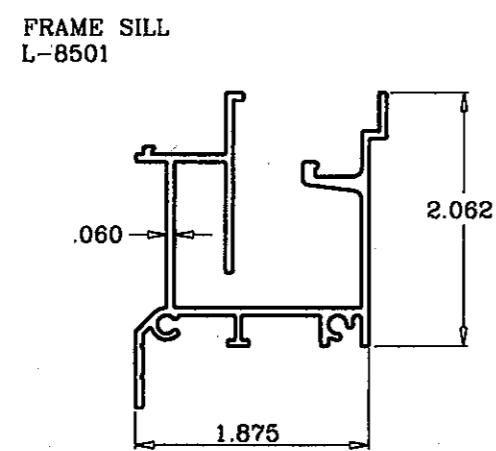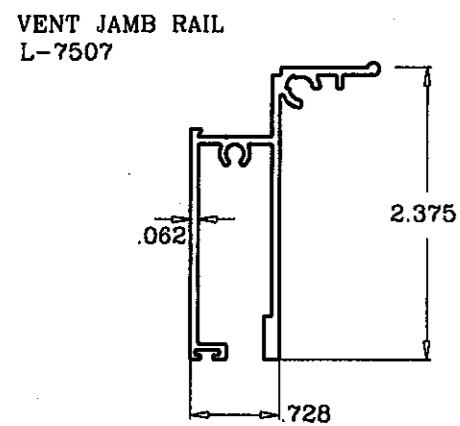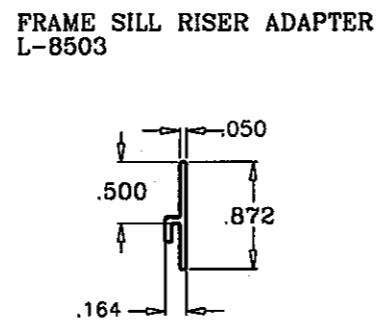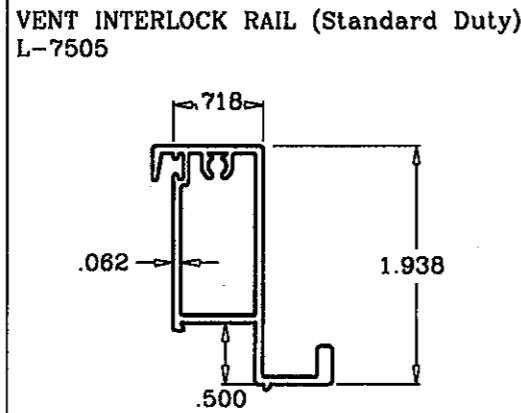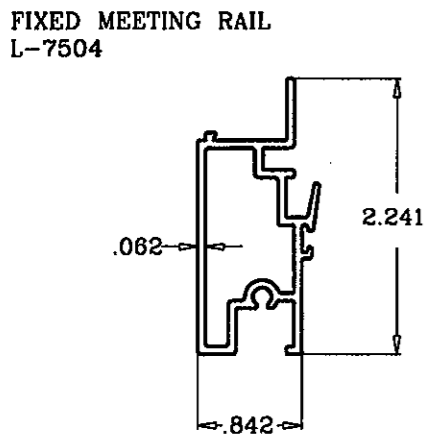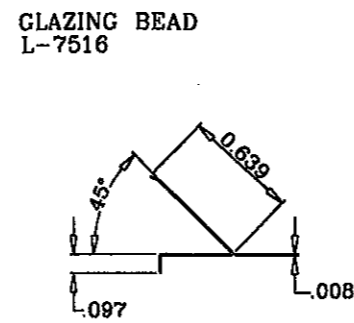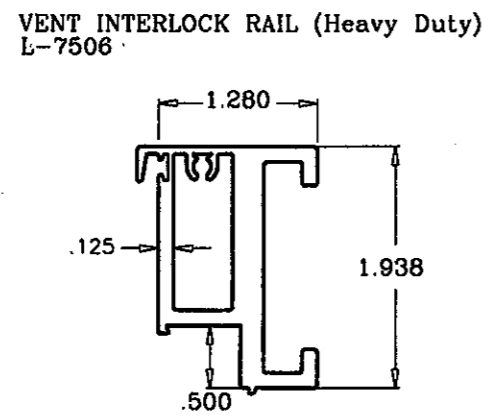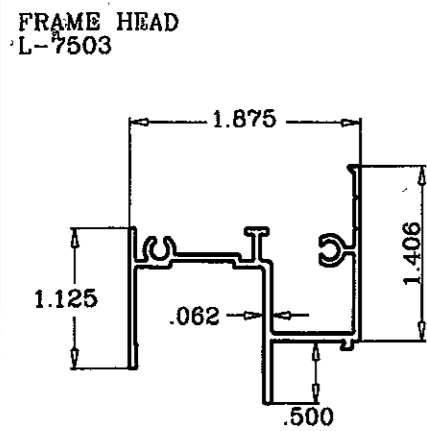

- NOTE: THE LOWER PRESSURES OF SINGLE HUNG WINDOW OR MULL SHALL GOVERN
- ALL STEEL IN CONTACT WITH ALUM. TO BE PAINTED OR PLATED.
 - METAL STRUCTURES: (STEEL OR ALUM. 1/8" MIN. THICK)
 - STEEL : Fy = 36 KSI MIN.
 - ALUMINUM : 6063-T5 MIN.

(E)

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 10-1025-04
Expiration Date: JAN 26, 2016
By: *Manuel Perez*
Miami Dade Product Control Division

LAWSON
INDUSTRIES, INC.

8501 N.W. 90 ST.
MEDLEY, FLORIDA 33166
PH No. (305) 696-8660

MANUFACTURER OF QUALITY ALUMINUM WINDOWS AND GLASS DOORS

HS-8500 HORIZONTAL ROLLING FLANGE WINDOW
EXTRUSION DETAILS, CORNER ASSEMBLY DETAILS & METAL ATTACHMENT DETAILS

Revision Notes:
Rev. A - Add 1/8" temp glass to XO configuration, sill anchor option & poly cam lock option.

Drawn By: N. ERAZO	Date Drawn: 05/02/05
Checked By: N. ERAZO	Date Revised: 07/2/08
Revision Level:	Scale:

THOMAS HARRIS
PROFESSIONAL ENGINEER
NO. 55225
STATE OF FLORIDA
LICENSED PROFESSIONAL ENGINEER

DATE